



TIA-568.0-D

TIA-568.1-D

TIA-568.2-D

TIA-568.3-D

TIA-569-D

TIA-606-C

TIA-607-C

TIA-862-B

TIA-942-B

TIA-1005-A

TIA-1179-A

ISO/IEC 11801

IEEE 802.3

IEEE 802.11



STANDARDS REFERENCE GUIDE

1.800.ANIXTER | anixter.com

Build. Connect. Power. Protect. Services. Worldwide.

The Anixter Difference

At Anixter, we help build, connect, power and protect valuable assets and critical infrastructures. From enterprise networks to industrial support and supplies to video surveillance applications and electric power transmission and distribution, we offer full-line solutions—and intelligence—that create reliable, resilient systems that can sustain your business and community.

Through our unmatched global distribution network, supply chain management expertise and technical know-how, we drive efficiency and effectiveness to benefit your bottom line.

How We Help



**TECHNOLOGY
ADVISORS**



**SUPPLY CHAIN
SPECIALISTS**



**GLOBAL
DISTRIBUTION
EXPERTS**

What We Do



**SAVE
TIME**



**REDUCE
COSTS**



**INCREASE
EFFICIENCY**



**MITIGATE
RISKS**

Purpose of Industry Standards

Industry standards guide the installation, maintenance and testing of products and technologies for a variety of security, industrial and enterprise networks. Today's standards are designed to provide critical uptime, support mission-critical applications, create operational efficiencies and increase productivity. They also allow for open-architecture systems that promote multimanufacturer environments that enable organizations to freely choose the solutions that best fit their needs. Standards provide recommended best practices to support a variety of existing and future systems to extend the life span of the infrastructure.

Anixter strives to be the industry expert within the data center, security, in-building wireless, industrial communication, wire and cable and utility power industries. Anixter is active within a number of industry associations and participates in committees and organizations around the world and continues to educate customers on updates, announcements and meaningful benefits that are grounded in those standards and best practices.

SCOPE OF THIS GUIDE

This document is meant as a reference that highlights the key points of the TIA-568.0-D, TIA-568.1-D, TIA-568.2-D, TIA-568.3-D, TIA-569-D, TIA-606-C, TIA-607-C, TIA-862-B, TIA-942-B, TIA-1005-A, TIA-1179-A, ISO/IEC 11801, ISO/IEC 11801, IEEE 802.3 and IEEE 802.11 standards.

It is not intended as a substitute for the original documents. For further information on any topic in the guide, refer to the actual standard. See the section called "Obtaining Standards Documents" for instructions on how to order a copy of the standard itself.

Abbreviation References

ASTM	American Society for Testing and Materials
CSA	Canadian Standards Association
IEC	International Electrotechnical Commission
IEEE	Institute of Electrical & Electronics Engineers
ISO	International Organization for Standardization
NEC	National Electrical Code® (NEC®)
NEMA	National Electrical Manufacturers Association
NFPA	National Fire Protection Association
TIA	Telecommunications Industry Association

THE ANIXTER INFRASTRUCTURE SOLUTIONS LABSM

Anixter's Infrastructure Solutions Lab is at the center of a worldwide collection of technical facilities that research, test and evaluate products to help customers meet their application challenges. This world-class research and educational center encompasses more than 4,000 square feet where Anixter's technical experts push the boundaries of technology, products and solutions.

Our mission for The Lab is simple – educate, demonstrate and evaluate.

- **Educate** customers on the latest industry standards and technologies
- **Demonstrate** the latest infrastructure and security product solutions available from our manufacturer partners
- **Evaluate** our network infrastructure and security solutions to make sure that our customers are selecting the right products for their specific needs

We are continually testing products in The Lab to establish that:

- Quality products are recommended and delivered to our customers
- Performance across product lines and within systems is consistent
- Products and systems recommended to customers can be integrated and follow the trend toward convergence.

Networking and security product testing at The Lab includes:

- Random performance testing of Anixter's inventory to make sure products comply to standards
- Network throughput and interoperability testing
- Copper and fiber cabling compliance verification (TIA, ISO/IEC, IEEE)
- Customer proof of concept
- Power over Ethernet (PoE)
- Application testing
- 10 Gig Ethernet cabling testing
- Video over IP, video quality and bandwidth utilization
- Power over Ethernet capability and verification
- Digital compression image quality vs. analog technology testing
- Evaluation of analog and IP cameras, video management software evaluation, DVR, NDVR and NVR products.

Register for a Lab visit or take a video tour: anixter.com/lab



ANIXTER'S 10 GIGABIT ETHERNET CABLING TESTING

The structured cabling performance test processes of Anixter's Infrastructure Solutions lab have been UL Verified to conduct rigorous, independent third-party testing of 10 Gigabit cabling solutions. Anixter's 10 Gigabit cabling testing examines electrical characteristics such as insertion loss, return loss and crosstalk, but also looks at alien crosstalk (which is part of the TIA-568.2-D Category 6A specification). To make sure the 10 Gigabit cabling solutions we sell meet the highest levels of performance and reliability, the Anixter Infrastructure Solutions Lab tests the toughest performance parameter, alien crosstalk, in the "worst-case" scenario. Customers can rest assured that the cabling solutions Anixter sells will provide the network performance they require.

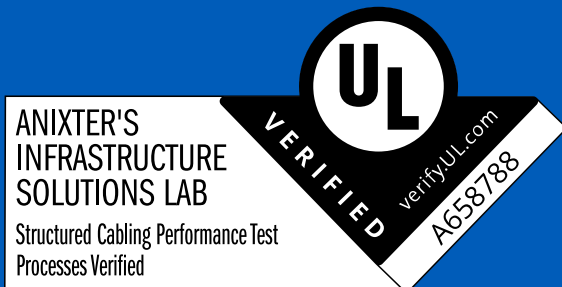




TABLE OF CONTENTS

TIA-568.0-D Generic Telecommunications	
Cabling for Customer Premises	8
TIA-568.1-D Commercial Building Telecommunications	
Cabling Standard	19
TIA-568.2-D Balanced Twisted-Pair Telecommunications	
Cabling and Components Standard	29
TIA-568.3-D Optical Fiber Cabling Components.....	53
TIA-569-D Telecommunications Pathways and Spaces.....	57
TIA-606-C Administration Standard for	
Telecommunications Infrastructure.....	81
TIA-607-C Generic Telecommunications Bonding and Grounding	
(Earthing) for Customer Premises	97
TIA-862-B Building Automation Systems Cabling Standard	111
TIA-942-B Telecommunications Infrastructure	
Standard for Data Centers.....	117
TIA-1005-A Telecommunications Infrastructure Standard	
for Industrial Premises.....	125
TIA-1179-A Healthcare Facility Telecommunications	
Infrastructure Standard	143
ISO/IEC 11801 Generic Cabling for Customer Premises.....	155
IEEE 802.3 Standards	159
IEEE 802.3af Power over Ethernet (PoE) Standard	160
IEEE 802.3at Power over Ethernet+ (Plus) Standard.....	160
IEEE 802.3bt 4-Pair Power Over Ethernet (4PPoE) Standard.....	160
IEEE 802.3an Physical Layer and Management	
Parameters for 10 Gbps Operation Type 10GBASE-T.....	161
IEEE 802.3ba Media Access Control Parameters, Physical Layers and	
Management Parameters for 40 Gbps and 100 Gbps Operation.....	162
IEEE 802.11 Wireless Standard	163
Reference Documents.....	165
Technology Alliance Partners.....	168

PURPOSE OF THE TIA-568.0-D STANDARD

The TIA-568.0-D standard enables the planning and installation of a structured cabling system for all types of customer premises. It specifies a system that will support generic telecommunications cabling in a multiproduct, multi-manufacturer environment. By serving as the foundation for premises telecommunications cabling infrastructure, the TIA-568.0-D standard provides additional requirements for other standards specific to the type of premises (e.g., TIA-568.1-D contains additional requirements applicable to commercial building cable).

The standard specifies requirements for generic telecommunications cabling, including:

- Cabling system structures
- Topologies and distances
- Installation, performance and testing
- Optical fiber transmission and test requirements.

This standard replaces TIA/EIA-568-C.0 dated February, 2009 and its addenda.

SECTION CONTENTS

TIA-568.0-D

Generic Telecommunications Cabling for Customer Premises

Telecommunications Cabling System Structure	9
General	9
Topology.....	9
Equipment Outlets (EOs)	10
Distributors	10
Cabling Subsystem 1	10
Cabling Subsystem 2 and Cabling Subsystem 3	11
Recognized Cabling.....	11
Cabling Lengths.....	11
Cabling Installation Requirements.....	14
Balanced Twisted-Pair Cabling	14
Maximum Pulling Tension.....	14
Minimum Bend Radius	14
Cable.....	14
Cord Cable	14
Cable Termination	15
8-Position Modular Jack Pin-Pair Assignments	16
Cords and Jumpers.....	17
Bonding and Grounding Requirements for Screened Cabling.....	17
Optical Fiber Cabling.....	18
Minimum Bend Radius and Maximum Pulling Tension	18
Polarity	18

TELECOMMUNICATIONS CABLING SYSTEM STRUCTURE

General

Figure 1 shows a representative model of the functional elements of a generic cabling system for TIA-568.0-D. In a typical commercial building where TIA-568.1-D applies, Distributor C represents the main cross-connect (MC), Distributor B represents the intermediate cross-connect (IC), Distributor A represents the horizontal cross-connect (HC), and the equipment outlet (EO) represents the telecommunications outlet and connector.

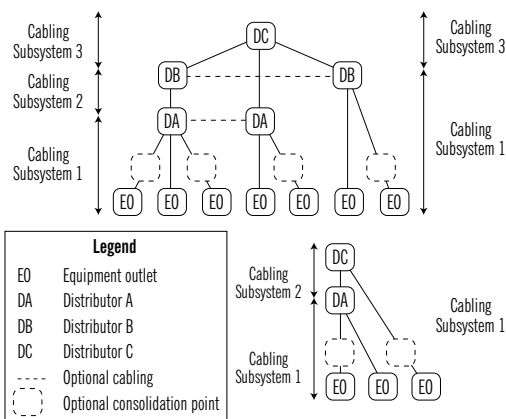


Figure 1 - Elements that comprise a generic cabling system

Topology

- Star topology
- No more than two distributors between Distributor C and an equipment outlet (EO)

Equipment Outlets (EOs)

Also called the work area (WA) in TIA-568.1-D, equipment outlets are the outermost location to terminate the cable in a hierarchical star topology.

Distributors

Distributors provide a location for administration, reconfiguration and connection of equipment and testing. They can be either interconnections or cross-connections.

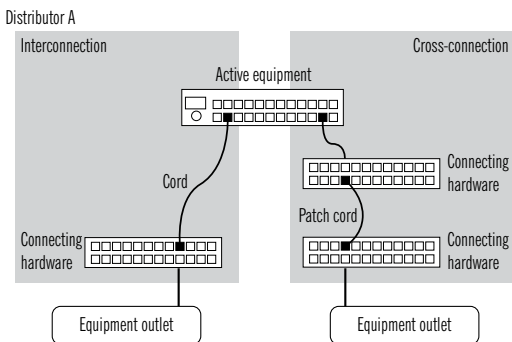


Figure 2 - Interconnections and cross-connections

Cabling Subsystem 1

- Provides a signal path between Distributor A, Distributor B or Distributor C and an EO (see [Figure 1](#)).
- Contains no more than one transition point or consolidation point.
- Stipulates that splices shall not be installed as part of a balanced twisted-pair cabling subsystem and that splitters shall not be installed as part of optical fiber for Cabling Subsystem 1.

Cabling Subsystem 2 and Cabling Subsystem 3

Cabling Subsystem 2 and Cabling Subsystem 3 provide signal paths between distributors (see [Figure 1](#)). The use of Distributor B is optional.

Recognized Cabling

The recognized media, which shall be used individually or in combination, are:

- 100-ohm balanced twisted-pair cabling
- Multimode optical fiber cabling
- Single-mode optical fiber cabling.

Cabling media other than those recognized above may be specified by the appropriate premises cabling standards.

Cabling Lengths

Cabling lengths are dependent upon the application and upon the specific media chosen (see following tables).

Cabling lengths			
Application	Media	Distance m (ft.)	Comments
Ethernet 10BASE-T	Category 3, 5e, 6, 6A	100 (328)	
Ethernet 100BASE-TX	Category 5e, 6, 6A	100 (328)	
Ethernet 1000BASE-T	Category 5e, 6, 6A	100 (328)	
Ethernet 10GBASE-T	Category 6A	100 (328)	
ASDL	Category 3, 5e, 6, 6A	5,000 (16,404)	1.5 Mbps to 9 Mbps
VDSL	Category 3, 5e, 6, 6A	5,000 (16,404)	1,500 m (4,900 ft.) for 12.9 Mbps; 300 m (1,000 ft.) for 52.8 Mbps
Analog phone	Category 3, 5e, 6, 6A	800 (2,625)	
Fax	Category 3, 5e, 6, 6A	5,000 (16,404)	
ATM 25.6	Category 3, 5e, 6, 6A	100 (328)	
ATM 51.84	Category 3, 5e, 6, 6A	100 (328)	
ATM 155.52	Category 5e, 6, 6A	100 (328)	
ATM 1.2G	Category 6, 6A	100 (328)	
ISDN BRI	Category 3, 5e, 6, 6A	5,000 (16,404)	128 kbps
ISDN PRI	Category 3, 5e, 6, 6A	5,000 (16,404)	1.472 Mbps

Table 2.2 – Maximum supportable distances for balanced twisted-pair cabling by application, which includes horizontal and backbone cabling (application-specific)

	Parameter	Multimode						Single-mode	
		62.5/125 μm TIA 492AAAA (OM1)		50/125 μm TIA 492AAB (OM2)		850 nm laser-optimized 50/125 μm TIA 492AAAC (OM3)		TIA 492CAA (OS1)	TIA 492CAAB (OS2)
Application	Nominal wavelength (nm)	850	1300	850	1300	850	1300	1310	1550
Ethernet 10/100BASE-SX	Channel attenuation (dB)	4.0	-	4.0	-	4.0	-	-	-
	Supportable distance m (ft.)	300 (984)	-	300 (984)	-	300 (984)	-	-	-
Ethernet 100BASE-FX	Channel attenuation (dB)	-	11.0	-	6.0	-	6.0	-	-
	Supportable distance m (ft.)	-	2,000 (6,850)	-	2,000 (6,850)	-	2,000 (6,850)	-	-
Ethernet 1000BASE-SX	Channel attenuation (dB)	2.6	-	3.6	-	4.5	-	-	-
	Supportable distance m (ft.)	275 (900)	-	550 (1,804)	-	800 (2,625)	-	-	-
Ethernet 1000BASE-LX	Channel attenuation (dB)	-	2.3	-	2.3	-	2.3	4.5	-
	Supportable distance m (ft.)	-	550 (1,804)	-	550 (1,804)	-	550 (1,804)	5,000 (16,405)	-
Ethernet 10GBASE-S	Channel attenuation (dB)	2.4	-	2.3	-	2.6	-	-	-
	Supportable distance m (ft.)	33 (108)	-	82 (269)	-	300 (984)	-	-	-
Ethernet 10GBASE-LX4	Channel attenuation (dB)	-	2.5	-	2.0	-	2.0	6.3	-
	Supportable distance m (ft.)	-	300 (984)	-	300 (984)	-	300 (984)	10,000 (32,810)	-
Ethernet 10GBASE-L	Channel attenuation (dB)	-	-	-	-	-	-	6.2	-
	Supportable distance m (ft.)	-	-	-	-	-	-	10,000 (32,810)	-
Ethernet 10GBASE-LRM	Channel attenuation (dB)	-	1.9	-	1.9	-	1.9	-	-
	Supportable distance m (ft.)	-	270 (720)	-	270 (720)	-	270 (720)	-	-
Fibre Channel 100-MX-SN-1 (1062 Mbaud)	Channel attenuation (dB)	3.0	-	3.9	-	4.6	-	-	-
	Supportable distance m (ft.)	300 (984)	-	500 (1,640)	-	880 (2,822)	-	-	-

Table 2.3 – Maximum supportable distances and attenuation for optical fiber applications (more on next table)

	Parameter	Multimode						Single-mode	
		62.5/125 μm TIA 492AAAA (OM1)		50/125 μm TIA 492AAAB (OM2)		850 nm laser-optimized 50/125 μm TIA 492AAAC (OM3)		TIA 492CAAA (OS1)	TIA 492CAAB (OS2)
Application	Nominal wavelength (nm)	850	1300	850	1300	850	1300	1310	1550
Fibre Channel 100-SM-LC-L (1062 Mbaud)	Channel attenuation (dB)	-	-	-	-	-	-	7.8	-
	Supportable distance m (ft.)	-	-	-	-	-	-	10,000 (32,810)	-
Fibre Channel 200-MX-SN-I (2125 Mbaud)	Channel attenuation (dB)	2.1	-	2.6	-	3.3	-	-	-
	Supportable distance m (ft.)	150 (492)	-	300 (984)	-	500 (1,640)	-	-	-
Fibre Channel 200-SM-LC-L (2125 Mbaud)	Channel attenuation (dB)	-	-	-	-	-	-	7.8	-
	Supportable distance m (ft.)	-	-	-	-	-	-	10,000 (32,810)	-
Fibre Channel 400-MX-SN-I (4250 Mbaud)	Channel attenuation (dB)	1.8	-	2.1	-	2.5	-	-	-
	Supportable distance m (ft.)	70 (230)	-	150 (492)	-	270 (886)	-	-	-
Fibre Channel 400-SM-LC-L (4250 Mbaud)	Channel attenuation (dB)	-	-	-	-	-	-	7.8	-
	Supportable distance m (ft.)	-	-	-	-	-	-	10,000 (32,810)	-
Fibre Channel 1200-MX-SN-I (10512 Mbaud)	Channel attenuation (dB)	2.4	-	2.2	-	2.6	-	-	-
	Supportable distance m (ft.)	33 (108)	-	82 (269)	-	300 (984)	-	-	-
Fibre Channel 1200-SM-LL-L (10512 Mbaud)	Channel attenuation (dB)	-	-	-	-	-	-	6.0	-
	Supportable distance m (ft.)	-	-	-	-	-	-	10,000 (32,810)	-
FDDI PMD X3.166	Channel attenuation (dB)	-	11.0	-	6.0	-	6.0	-	-
	Supportable distance m (ft.)	-	2,000 (6,560)	-	2,000 (6,560)	-	2,000 (6,560)	-	-
FDDI SMF-PMD X3.184	Channel attenuation (dB)	-	-	-	-	-	-	10.0	-
	Supportable distance m (ft.)	-	-	-	-	-	-	10,000 (32,810)	-

Table 3 – Maximum supportable distances and attenuation for optical fiber applications

CABLING INSTALLATION REQUIREMENTS

- Cabling installations shall comply with the authority having jurisdiction (AHJ) and applicable regulations.
- Cable stress caused by suspended cable runs and tightly cinched bundles should be minimized.
- Cable bindings, which are used to tie multiple cables together, should be irregularly spaced and should be loosely fitted (easily movable).

Balanced Twisted-Pair Cabling

Maximum Pulling Tension

- The pulling tension for a 4-pair balanced twisted-pair cable shall not exceed 110 N (25 pound-force) during installation.
- For multipair cable, manufacturers' pulling tension guidelines shall be followed.

Minimum Bend Radius

Cable

- The minimum inside bend radius, under no-load or load, for a 4-pair balanced twisted-pair cable shall be four times the cable diameter.
- The minimum bend radius, under no-load or load, for a multipair cable shall follow the manufacturer's guidelines.

Cord Cable

- The minimum inside bend radius for a 4-pair balanced twisted-pair cord cable shall be one times the cord cable diameter.

Cable Termination

- Cables should be terminated with connecting hardware of the same performance (Category) or higher.
- The Category of the installed link should be suitably marked and noted in the administrative records.
- The cable geometry shall be maintained as close as possible to the connecting hardware and its cable termination points.
- The maximum pair untwist for the balanced twisted-pair cable termination shall be in accordance with [Table 4](#).

Pair untwist lengths	
Category	Maximum pair untwist mm (in.)
3	75 (3)
5e	13 (0.5)
6	13 (0.5)
6A	13 (0.5)

Table 4 – Maximum supportable pair untwist length for Category cable termination

8-Position Modular Jack Pin-Pair Assignments

Pin-pair assignments shall be as shown in [Figure 3](#) or, optionally, per [Figure 4](#) if it is necessary to accommodate certain 8-pin cabling systems. The colors shown are associated with 4-pair cable.




Figure 3 – Front view of 8-position jack pin-pair assignments (T568A)




Figure 4 – Front view of optional 8-position jack pin-pair assignment (T568B)

Cords and Jumpers

Cross-connect jumpers and modular plug cords should be of the same Category or higher as the Category of the cabling to which they connect. It is recommended that modular cords be factory manufactured.

Bonding and Grounding Requirements for Screened Cabling

- The screen of screened twisted-pair (ScTP) cables shall be bonded to the telecommunications grounding busbar (TGB) or telecommunications main grounding busbar (TMGB).
- A voltage greater than 1 volt rms between the cable screen and the ground of the corresponding electrical outlet used to provide power to the equipment indicates improper grounding.

Optical Fiber Cabling

Minimum Bend Radius and Maximum Pulling Tension

Measured to the inside curvature, the bend radius is the minimum a cable can bend without any risk to kinking it, damaging it or shortening its life. The smaller the bend radius, the greater the material flexibility.

Minimum bend radius and maximum pulling tension			
Cable type and installation details	Maximum tensile load during installation	Minimum bend radii while subjected to maximum tensile load (during installation)	No tensile load (after installation)
Inside plant cable with 2 or 4 fibers installed in Cabling Subsystem 1	220 n (50 lbf)	50 mm (2 in.)	25 mm (1 in.)
Inside plant cable with more than 4 fibers	Per manufacturer	20 times the cable outside diameter	10 times the cable outside diameter
Indoor/outdoor cable with up to 12 fibers	1335 n (300 lbf)	20 times the cable outside diameter	10 times the cable outside diameter
Indoor/outdoor cable with more than 12 fibers	2670 n (600 lbf)	20 times the cable outside diameter	10 times the cable outside diameter
Outside plant cable	2670 n (600 lbf)	20 times the cable outside diameter	10 times the cable outside diameter
Drop cable installed by pulling	1335 n (300 lbf)	20 times the cable outside diameter	10 times the cable outside diameter
Drop cable installed by directly burying, trenching or blowing into ducts	440 n (100 lbf)	20 times the cable outside diameter	10 times the cable outside diameter

Table 5 - Maximum and minimum pulling tension and bend radius for different cable types

Polarity

Transmit-to-receive polarity must be maintained throughout the cabling system. (TIA-568.3-D describes methods to do this.)

PURPOSE OF THE TIA-568.1-D STANDARD

The purpose of this standard is to provide guidance on the planning and installation of a structured cabling system for commercial buildings.

SECTION CONTENTS

TIA-568.1-D

Commercial Building Telecommunications Cabling Standard

Commercial Building Telecommunications Cabling Standard	20
Entrance Facilities.....	20
Equipment Rooms (ERs).....	20
Telecommunications Rooms (TRs) and Telecommunications Enclosures (TEs).....	20
Centralized Optical Fiber Cabling.....	21
Backbone Cabling (Cabling Subsystems 2 and 3).....	22
Length and Maximum Distances.....	22
Recognized Cabling.....	22
Horizontal Cabling (Cabling Subsystem 1).....	24
Recognized Cabling.....	24
Work Area.....	25
Open Office Cabling (MUTOA).....	26
Maximum Work Area Cord Lengths.....	27
Consolidation Point (CP).....	28

COMMERCIAL BUILDING TELECOMMUNICATIONS CABLING STANDARD

Entrance Facilities

- Entrance facilities (EFs) contain the cables, network demarcation point(s), connecting hardware, protection devices and other equipment that connects to the access provider (AP) or private network cabling.
- Entrance facilities include connections between outside plant and inside building cabling.

Equipment Rooms (ERs)

- Equipment rooms are considered to be distinct from telecommunications rooms (TRs) and telecommunications enclosures (TEs) because of the nature or complexity of the equipment they contain. An ER may alternatively provide any or all of the functions of a TR or TE.
- The main cross-connect (MC, Distributor C) of a commercial building is located in an ER. Intermediate cross-connects (ICs, Distributor B), horizontal cross-connects (HCs, Distributor A), or both, of a commercial building may also be located in an ER.

Telecommunications Rooms (TRs) and Telecommunications Enclosures (TEs)

- Telecommunications rooms and enclosures provide a common access point for backbone and building pathways (see [Figure 5](#)) and cabling used for cross-connection.
- The horizontal cross-connect (HC, Distributor A) of a commercial building is located in a TR or TE. The main cross-connect (MC, Distributor C) and intermediate cross-connects (IC, Distributor B) of a commercial building may also be located in a TR. The TR and any TE should be located on the same floor as the work areas served.
- The telecommunications enclosure (TE) is intended to serve a smaller floor area than a TR and may be used in addition to the “minimum one TR per floor” rule.

Centralized Optical Fiber Cabling (see Figure 5)

- Centralized optical fiber cabling is designed as an alternative to the optical cross-connect located in the TR or TE in support of installing centralized electronics.
- It provides connections from work areas (WAs) to centralized cross-connects by allowing the use of pull-through cables and the use of an interconnect or splice in the TR or TE.
- The maximum allowed distance for a pull-through cable is 90 m (295 ft.).

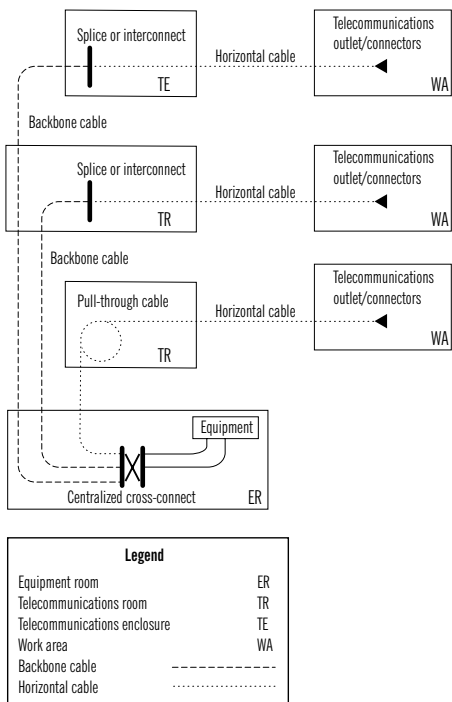


Figure 5 - Centralized optical fiber cabling

Backbone Cabling (Cabling Subsystems 2 and 3)

- Provides interconnections between entrance facilities (EFs), access provider (AP) spaces, service provider (SP) spaces, common equipment rooms (CERs), common telecommunications rooms (CTRs), equipment rooms (ERs), telecommunications rooms (TRs) and telecommunications enclosures (TEs) (see [Figure 5](#)).
- Makes sure that the backbone cabling shall meet the requirements of TIA-568.1-D Cabling Subsystem 2 and Cabling Subsystem 3.
- Uses a star topology (see [Figure 6](#)).
- Allows for no more than two hierarchical levels of cross-connects.

Length and Maximum Distances

- Backbone cabling length extends from the termination of the media at the MC to an IC or HC.
- Cabling lengths are dependent on the application and the media chosen. They are found in the previous section covering TIA-568.0-D (see [Tables 1, 2 and 3](#)).
- The length of the cross-connect jumpers and patch cords in the MC or IC should not exceed 20 m (66 ft.).
- The length of the cord used to connect telecommunications equipment directly to the MC or IC should not exceed 30 m (98 ft.).

Recognized Cabling

The recognized media, which shall be used individually or in combination, are:

- 100-ohm balanced twisted-pair cabling (Category 3, 5e, 6 or 6A)
- Multimode optical fiber cabling, 2-fiber (or higher count), OM4 or higher recommended.
- Single-mode optical fiber cabling, 2-fiber (or higher count).
- Broadband coaxial cabling.

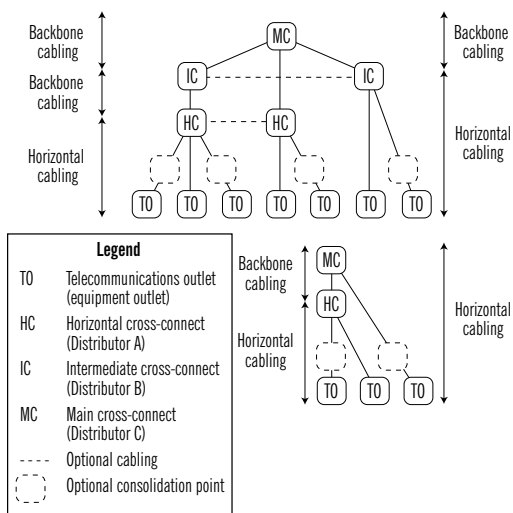


Figure 6 - Commercial building hierarchical star topology

Horizontal Cabling (Cabling Subsystem 1)

- Horizontal cabling (see [Figure 7](#)) includes horizontal cable, telecommunications outlets and connectors in the work area (WA); mechanical terminations and patch cords or jumpers located in a telecommunications room (TR) or telecommunications enclosure (TE); and may incorporate multiuser telecommunications outlet assemblies (MUTOAs) and consolidation points (CPs).
- A minimum of two permanent links shall be provided for each work area.
- Each 4-pair cable at the equipment outlet shall be terminated in an 8-position modular jack.
- Optical fibers at the equipment outlet shall be terminated to a duplex optical fiber outlet and connector.
- Horizontal cabling uses a star topology.
- The maximum horizontal cable length shall be 90 m (295 ft.), independent of media type. If a MUTOA is deployed, the maximum horizontal balanced twisted-pair copper cable length shall be reduced in accordance with [Table 6](#) (page 23).
- The length of the cross-connect jumpers and patch cords that connect horizontal cabling with equipment or backbone cabling should not exceed 5 m (16 ft.).
- For each horizontal channel, the total length allowed for cords in the WA, plus patch cords or jumpers and equipment cords in the TR or TE, shall not exceed 10 m (33 ft.) unless a MUTOA is used.

Recognized Cabling

The recognized media, which shall be used individually or in combination, are:

- 4-pair 100-ohm unshielded or shielded twisted-pair cabling (Category 3, 5e, 6 or 6A). NOTE – To support a wide range of applications, Category 6A may be required.
- Multimode optical fiber cabling, 2-fiber (or higher count)), OM4 or higher recommended.
- Single-mode optical fiber cabling, 2-fiber (or higher count).
- Broadband coaxial cabling.

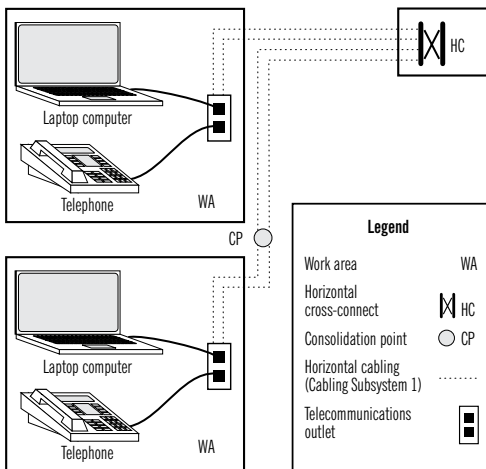


Figure 7 - Typical horizontal and work area cabling using star topology

Work Area

- The telecommunications outlet and connector shall meet the requirements of TIA-568.0-D.
- The work area (WA) components extend from the telecommunications outlet/connector end of the horizontal cabling system to the WA equipment.
- When application-specific adapters are needed at the WA, they shall be external to the telecommunications outlet and connector.

Open Office Cabling (MUTOA)

Open office design practices use multiuser telecommunications outlet assemblies (MUTOAs), consolidation points (CPs) or both to provide flexible layouts. MUTOAs allow horizontal cabling to remain intact when the open office plan is changed.

- WA cords originating from the MUTOA should be routed through WA pathways (e.g., furniture pathways).
- The WA cables shall be connected directly to workstation equipment without the use of any additional intermediate connections (see [Figure 8](#)).
- MUTOAs shall be located in fully accessible, permanent locations, such as building columns and permanent walls. They should not be located in ceiling spaces, obstructed areas or in furniture unless the furniture is secured to the building structure.

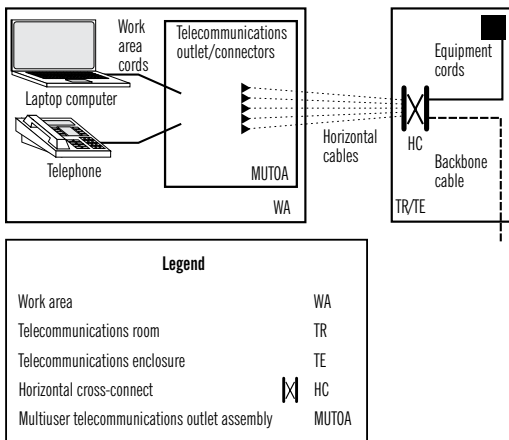


Figure 8 - Multiuser telecommunications outlet assembly (MUTOA) application

Maximum Work Area Cord Lengths

- Balanced twisted-pair WA cables: the maximum cord length used in the context of MUTOAs and open office furniture is as follows in [Table 6](#).
- Optical fiber WA cords: the maximum horizontal cabling length is not affected by the deployment of a MUTOA.

Maximum length of horizontal cables and work area cords				
Length of horizontal cable	24 AWG cords		26 AWG cords	
	Maximum length of work area cord	Maximum combined length of work area cord, patch cords and equipment cord	Maximum length of work area cord	Maximum combined length of work area cord, patch cords and equipment cord
H m (ft.)	W m (ft.)	C m (ft.)	W m (ft.)	C m (ft.)
90 (295)	5 (16)	10 (33)	4 (13)	8 (26)
85 (279)	9 (30)	14 (46)	7 (23)	11 (35)
80 (262)	13 (44)	18 (59)	11 (35)	15 (49)
75 (246)	17 (57)	22 (72)	14 (46)	18 (59)
70 (230)	22 (72)	27 (89)	17 (56)	21 (70)

Table 6 – Maximum length of work area cord in relation to horizontal cable

Consolidation Point (CP)

The CP is an interconnection point within the horizontal cabling. It differs from the MUTOA in that a CP requires an additional connection for each horizontal cable run. It may be useful when reconfiguration is frequent, but not so frequent as to require the flexibility of a MUTOA (see Figure 9).

- The CP should be located at least 15 m (49 ft.) from the TR or TE.
- Cross-connections shall not be used at a CP.
- Each horizontal cable extending to the WA outlet from the CP shall be terminated to a telecommunications outlet/connector or MUTOA.
- CPs shall be located in fully accessible, permanent locations such as building columns and permanent walls. They should not be located in obstructed areas or in furniture unless the furniture is secured to the building structure.

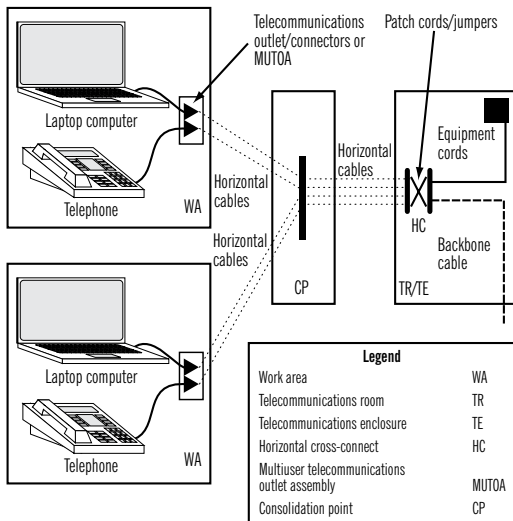


Figure 9 - Application of consolidation point

PURPOSE OF THE TIA-568.2-D STANDARD

This standard includes component and cabling specifications as well as testing requirements for copper cabling, including Category 3, Category 5e, Category 6 and Category 6A. It also introduces performance requirements and test measurement methodologies for Category 8 shielded cabling and components.

SECTION CONTENTS

TIA-568.2-D


Balanced Twisted-Pair Telecommunications Cabling and Components Standard

Balanced Twisted-Pair Telecommunications Cabling and Components Standard	30
Channel and Permanent Link Test Configurations.....	30
Definitions of Electrical Parameters.....	32
Recognized Categories of Balanced Twisted-Pair Cabling and Components	34
Channel Transmission Performance.....	35
Channel Propagation Delay Skew	38
Augmented Category 6 Channel Requirements.....	39
Permanent Link Transmission Performance	40
Permanent Link Propagation Delay Skew	43
Horizontal Cable Transmission Performance.....	44
Horizontal Cable Propagation Delay Skew.....	47
Bundled and Hybrid Cable.....	50
Patch Cord Transmission Performance	50
Patch Cord Cable Construction	51

BALANCED TWISTED-PAIR TELECOMMUNICATIONS CABLING AND COMPONENTS STANDARD

Channel and Permanent Link Test Configurations

For the purpose of testing twisted-pair cabling systems, the worst-case cabling channel configuration is assumed to contain a telecommunications outlet and connector, a transition point, 90 meters of twisted-pair cable, a cross-connect consisting of two blocks or panels and a total of 10 meters of patch cords. The figure below shows the relationship of these components.



Legend			
Cables and cords		Connecting hardware	
Work area cord	A	Telecommunications outlet/connector	TO
Optional consolidation point cabling	B	Optional consolidation point connector	CP
Horizontal cabling	C	Horizontal cross-connect or interconnect	C1, C2
Patch cord or jumper cable	D		
Telecommunications room equipment cord	E		
Maximum length			
	B + C	90 m (295 ft.)	
	A + D + E	10 m (32.8 ft.)	

Figure 10 – Channel test configuration

The permanent link test configuration includes the horizontal distribution cable, telecommunications outlet and connector or transition point and one horizontal cross-connect component including the mated connections. This is assumed to be the permanent part of a link. The channel is comprised of the permanent link plus cross-connect equipment, user equipment cord and cross-connect patch cable.

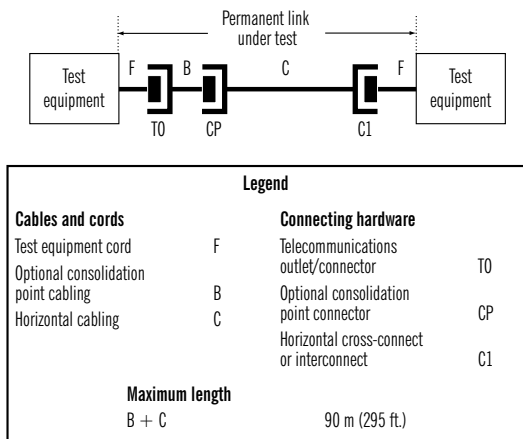


Figure 11 – Permanent link test configuration

Definitions of Electrical Parameters

Return loss: A measure of the degree of impedance mismatch between two impedances. It is the ratio, expressed in decibels, of the amplitude of a reflected wave echo to the amplitude of the main wave at the junction of a transmission line and a terminating impedance.

Insertion loss: This term has replaced the term “attenuation” (ATTN). It is a measure of the decrease of signal strength as it travels down the media.

NEXT loss (near-end crosstalk): A measure of the unwanted signal coupling from a transmitter at the near-end into a neighboring (nonenergized) pair measured at the near-end.

PSNEXT loss (powersum near-end crosstalk): A computation of the unwanted signal coupling from multiple transmitters at the near-end into a neighboring (nonenergized) pair measured at the near-end.

FEXT loss (far-end crosstalk): A measure of the unwanted signal coupling from a transmitter at the near-end into a neighboring pair measured at the far-end.

ACRF (attenuation to crosstalk ratio, far-end) or ELFEXT (equal-level far-end crosstalk): A measure of the unwanted signal coupling from a transmitter at the near-end into a neighboring pair measured at the far-end, relative to the received signal level measured on that same pair.

PSFEXT loss (powersum far-end crosstalk): A computation of the unwanted signal coupling from multiple transmitters at the near-end into a neighboring pair measured at the far-end.

PSACRF (powersum attenuation to crosstalk ratio, far-end) or PSELFEXT (powersum equal-level far-end crosstalk): A computation of the unwanted signal coupling from multiple transmitters at the near-end into a neighboring pair measured at the far-end, relative to the received signal level measured on that same pair.

Propagation delay: The time needed for the transmission of signal to travel the length of a single pair.

Propagation delay skew: The difference between the propagation delay of any two pairs within the same cable sheath. Delay skew is caused primarily because twisted-pair cable is designed to have different twists per foot (lay lengths). Delay skew could cause data transmitted over one wire pair to arrive out of sync with data over another wire pair.

ANEXT loss (alien near-end crosstalk): A measure of signal coupling from a near-end disturbing pair into a disturbed pair of a neighboring cable or connector pair or part thereof, measured at the near-end.

PSANEXT loss (powersum alien near-end crosstalk): A computation of signal coupling from multiple near-end disturbing pairs into a disturbed pair of a neighboring channel, cable or connector pair or part thereof, measured at the near-end.

AFEXT loss (alien far-end crosstalk): A measure of signal coupling from a near-end disturbing pair into a disturbed pair of a neighboring cable or connector pair or part thereof, measured at the far-end.

PSAFEXT loss (powersum alien far-end crosstalk): A computation of signal coupling from multiple near-end disturbing channel pairs into a disturbed pair of a neighboring channel or part thereof, measured at the far-end.

PSAACRF (powersum alien attenuation to crosstalk ratio, far-end) or PSAELFEXT (powersum alien equal-level far-end crosstalk): A computation of signal coupling from multiple pairs of disturbing channels to a disturbed pair in another channel measured at the far-end and relative to the received signal level in the disturbed pair at the far-end.

Recognized Categories of Balanced Twisted-Pair Cabling and Components

As data transmission rates have increased, higher performance twisted-pair cabling has become a necessity. In addition, some means of classifying horizontal twisted-pair cables and connecting hardware by performance capability had to be established. These capabilities have been broken down to a series of categories. The following categories are currently recognized.

Category 3: Cables and connecting hardware with transmission parameters characterized up to 16 MHz

Category 5e: Cables and connecting hardware with transmission parameters characterized up to 100 MHz

Category 6: Cables and connecting hardware with transmission parameters characterized up to 250 MHz

Category 6A: Cables and connecting hardware with transmission parameters characterized up to 500 MHz. Additionally, requirements for alien crosstalk are specified in order to support 10GBASE-T transmission systems.

Category 8: Cables and connecting hardware with transmission parameters characterized up to 2000 MHz. Higher frequency requirements for alien crosstalk are specified in order to support 25/40GBASE-T transmission systems.

The following tables show the performance limits for channel, permanent link and twisted-pair cable for Category 3, Category 5e, Category 6, Category 6A, and Category 8.

Channel Transmission Performance

The following tables reflect the various mitigating factors that need to be taken into consideration when calculating a channel's transmission performance.

Channel return loss					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (db)
1.00	-	17.0	19.0	19.0	19.0
4.00	-	17.0	19.0	19.0	19.0
8.00	-	17.0	19.0	19.0	19.0
10.00	-	17.0	19.0	19.0	19.0
16.00	-	17.0	18.0	18.0	18.0
20.00	-	17.0	17.5	17.5	17.5
25.00	-	16.0	17.0	17.0	17.0
31.25	-	15.1	16.5	16.5	16.5
62.50	-	12.1	14.0	14.0	16.0
100.00	-	10.0	12.0	12.0	16.0
200.00	-	-	9.0	9.0	14.3
250.00	-	-	8.0	8.0	13.4
300.00	-	-	-	7.2	12.7
400.00	-	-	-	6.0	11.6
500.00	-	-	-	6.0	10.7
600.00	-	-	-	-	10.0
1000.00	-	-	-	-	8.0
1500.00	-	-	-	-	8.0
2000.00	-	-	-	-	8.0

Table 7 – Minimum channel return loss

Channel insertion loss					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (db)
1.00	3.0	2.2	2.1	2.3	3.0
4.00	6.5	4.5	4.0	4.2	3.0
8.00	9.8	6.3	5.7	5.8	3.0
10.00	11.2	7.1	6.3	6.5	3.0
16.00	14.9	9.1	8.0	8.2	3.0
20.00	-	10.2	9.0	9.2	3.0
25.00	-	11.4	10.1	10.2	3.0
31.25	-	12.9	11.4	11.5	3.6
62.50	-	18.6	16.5	16.4	5.1
100.00	-	24.0	21.3	20.9	6.5
200.00	-	-	31.5	30.1	9.3
250.00	-	-	35.9	33.9	10.4
300.00	-	-	-	37.4	11.5
400.00	-	-	-	43.7	13.3
500.00	-	-	-	49.3	15.0
600.00	-	-	-	-	16.5
1000.00	-	-	-	-	22.0
1500.00	-	-	-	-	27.7
2000.000	-	-	-	-	32.7

Table 8 – Maximum channel insertion loss

Channel NEXT loss (near-end crosstalk)					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	39.1	60.0	65.0	65.0	65.0
4.00	29.3	53.5	63.0	63.0	63.8
8.00	24.3	48.6	58.2	58.2	58.9
10.00	22.7	47.0	56.6	56.6	57.3
16.00	19.3	43.6	53.2	53.2	53.9
20.00	-	42.0	51.6	51.6	52.3
25.00	-	40.3	50.0	50.0	50.7
31.25	-	38.7	48.4	48.4	49.1
62.50	-	33.6	43.4	43.4	44.0
100.00	-	30.1	39.9	39.9	40.5
200.00	-	-	34.8	34.8	35.3
250.00	-	-	33.1	33.1	33.6
300.00	-	-	-	31.7	32.3
400.00	-	-	-	28.7	30.1
500.00	-	-	-	26.1	27.9
600.00	-	-	-	-	25.7
1000.00	-	-	-	-	19.3
1500	-	-	-	-	13.9
2000.00	-	-	-	-	9.8

Table 9 – Minimum channel NEXT loss

Channel PSNEXT loss (powersum near-end crosstalk)					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	57.0	62.0	62.0	62.0
4.00	-	50.5	60.5	60.5	60.5
8.00	-	45.6	55.6	55.6	55.6
10.00	-	44.0	54.0	54.0	54.0
16.00	-	40.6	50.6	50.6	50.6
20.00	-	39.0	49.0	49.0	49.0
25.00	-	37.3	47.3	47.3	47.3
31.25	-	35.7	45.7	45.7	45.7
62.50	-	30.6	40.6	40.6	40.6
100.00	-	27.1	37.1	37.1	37.1
200.00	-	-	31.9	31.9	31.9
250.00	-	-	30.2	30.2	30.2
300.00	-	-	-	28.8	28.8
400.00	-	-	-	25.8	26.6
500.00	-	-	-	23.2	24.8
600.00	-	-	-	-	22.7
1000.00	-	-	-	-	16.5
1500.00	-	-	-	-	11.2
2000.00	-	-	-	-	7.3

Table 10 – Minimum channel PSNEXT loss

Channel ACRF (attenuation to crosstalk ratio, far-end) or ELFEXT (equal-level far-end crosstalk)					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	57.4	63.3	63.3	65.0
4.00	-	45.4	51.2	51.2	59.9
8.00	-	39.3	45.2	45.2	53.9
10.00	-	37.4	43.3	43.3	52.0
16.00	-	33.3	39.2	39.2	47.9
20.00	-	31.4	37.2	37.2	45.9
25.00	-	29.4	35.3	35.3	44.0
31.25	-	27.5	33.4	33.4	42.1
62.50	-	21.5	27.3	27.3	36.0
100.00	-	17.4	23.3	23.3	32.0
200.00	-	-	17.2	17.2	25.9
250.00	-	-	15.3	15.3	24.0
300.00	-	-	-	13.7	22.4
400.00	-	-	-	11.2	19.9
500.00	-	-	-	9.3	18.0
600.00	-	-	-	-	16.4
1000.00	-	-	-	-	12.0
1500.00	-	-	-	-	8.4
2000.00	-	-	-	-	5.9

Table 11 – Minimum channel ACRF

Channel PSACRF (powersum insertion loss to alien crosstalk ratio far-end) or PSELFEXT (powersum equal-level far-end crosstalk)					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	54.4	60.3	60.3	62.0
4.00	-	42.4	48.2	48.2	56.9
8.00	-	36.3	42.2	42.2	50.9
10.00	-	34.4	40.3	40.3	49.0
16.00	-	30.3	36.2	36.2	44.9
20.00	-	28.4	34.2	34.2	42.9
25.00	-	26.4	32.3	32.3	41.0
31.25	-	24.5	30.4	30.4	39.1
62.50	-	18.5	24.3	24.3	33.0
100.00	-	14.4	20.3	20.3	29.0
200.00	-	-	14.2	14.2	22.9
250.00	-	-	12.3	12.3	21.0
300.00	-	-	-	10.7	19.4
400.00	-	-	-	8.2	16.9
500.00	-	-	-	6.3	15.0
600.00	-	-	-	-	13.4
1000.00	-	-	-	-	9.0
1500.00	-	-	-	-	5.4
2000.00	-	-	-	-	2.9

Table 12 – Minimum channel PSACRF

Channel Propagation Delay Skew

Channel propagation delay skew shall be less than 50 ns for all frequencies from 1 MHz to the upper frequency limit of the Category. For field-testing channels, it is sufficient to test at 10 MHz only and channel propagation delay skew at 10 MHz shall not exceed 50 ns.

Channel propagation delay					
Frequency (MHz)	Category 3 (ns)	Category 5e (ns)	Category 6 (ns)	Category 6A (ns)	Category 8 (ns)
1.00	580	580	580	580	187.4
4.00	562	562	562	562	181.5
8.00	557	557	557	557	179.8
10.00	555	555	555	555	179.4
16.00	553	553	553	553	178.6
20.00	-	552	552	552	178.3
25.00	-	551	551	551	178.0
31.25	-	550	550	550	177.8
62.50	-	549	549	549	177.2
100.00	-	548	548	548	176.8
200.00	-	-	547	547	176.5
250.00	-	-	546	546	176.4
300.00	-	-	-	546	176.3
400.00	-	-	-	546	176.3
500.00	-	-	-	546	176.2
600.00	-	-	-	-	176.1
1000.00	-	-	-	-	176.0
1500.00	-	-	-	-	176.0
2000.00	-	-	-	-	175.9

Table 13 - Maximum channel propagation delay

Channel PSANEXT loss (powersum alien near-end crosstalk)					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	-	-	67.0	75.0
4.00	-	-	-	67.0	75.0
8.00	-	-	-	67.0	75.0
10.00	-	-	-	67.0	75.0
16.00	-	-	-	67.0	75.0
20.00	-	-	-	67.0	75.0
25.00	-	-	-	66.0	75.0
31.25	-	-	-	65.1	75.0
62.50	-	-	-	62.0	75.0
100.00	-	-	-	60.0	75.0
200.00	-	-	-	55.5	75.0
250.00	-	-	-	54.0	75.0
300.00	-	-	-	52.8	75.0
400.00	-	-	-	51.0	75.0
500.00	-	-	-	49.5	74.5
600.00	-	-	-	-	73.3
1000.00	-	-	-	-	70.0
1500.00	-	-	-	-	67.4
2000.00	-	-	-	-	67.4

Table 14 - Minimum channel PSANEXT loss

Channel PSAACRF (powersum insertion loss to alien crosstalk ratio far-end) or PSAELFEXT (powersum alien equal level far-end crosstalk)

Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	-	-	67.0	75.0
4.00	-	-	-	65.0	75.0
8.00	-	-	-	58.9	75.0
10.00	-	-	-	57.0	75.0
16.00	-	-	-	52.9	75.0
20.00	-	-	-	51.0	75.0
25.00	-	-	-	49.0	73.0
31.25	-	-	-	47.1	71.1
62.50	-	-	-	41.1	65.1
100.00	-	-	-	37.0	61.0
200.00	-	-	-	31.0	55.0
250.00	-	-	-	29.0	53.0
300.00	-	-	-	27.5	51.5
400.00	-	-	-	25.0	49.0
500.00	-	-	-	23.0	47.0
600.00	-	-	-	-	45.4
1000.00	-	-	-	-	41.0
1500.00	-	-	-	-	37.5
2000.00	-	-	-	-	35.0

Table 15 – Minimum channel PSAACRF loss

Augmented Category 6 Channel Requirements

Note: The requirements for ISO (the International Organization for Standardization) ISO/IEC 11801 Class E_A are more demanding compared to the TIA Augmented Category 6 requirements. Anixter's Infrastructure Solutions Lab tests to the more stringent ISO/IEC 11801 standards.

ISO compared to TIA

Characteristics 500 MHz (dB)	ISO Class E _A	TIA Augmented Category 6
PSNEXT loss	24.8 dB	23.2 dB
NEXT loss	27.9 dB	26.1 dB
PSANEXT loss	49.5 dB	49.5 dB
Return loss	6.0 dB	6.0 dB
Insertion loss	49.3 dB	49.3 dB
Referred to by IEEE	Yes	No

Table 16 – ISO versus TIA performance comparison

Note: See the IEEE 802.3an and ISO/IEC 11801 Class E_A section of this book for more information on 10 Gigabit cabling and protocol methods.

Permanent Link Transmission Performance

The tables below show the requirements intended for performance validation according to the specific cabling Category.

Permanent link return loss					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	19.0	19.1	19.1	19.1
4.00	-	19.0	21.0	21.0	21.0
8.00	-	19.0	21.0	21.0	21.0
10.00	-	19.0	21.0	21.0	21.0
16.00	-	19.0	20.0	20.0	20.0
20.00	-	19.0	20.0	19.5	19.5
25.00	-	19.0	19.5	19.0	19.0
31.25	-	17.1	18.5	18.5	18.5
62.50	-	14.1	16.0	16.0	18.0
100.00	-	12.0	14.0	14.0	18.0
200.00	-	-	11.0	11.0	14.4
250.00	-	-	10.0	10.0	13.2
300.00	-	-	-	9.2	12.3
400.00	-	-	-	8.0	10.8
500.00	-	-	-	8.0	9.6
600.00	-	-	-	-	8.7
1000.00	-	-	-	-	8.0
1500.00	-	-	-	-	8.0
2000.00	-	-	-	-	8.0

Table 17 – Minimum permanent link return loss

Permanent link insertion loss					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	2.6	2.1	1.9	1.9	3.0
4.00	5.6	3.9	3.5	3.5	3.0
8.00	8.5	5.5	5.0	5.0	3.0
10.00	9.7	6.2	5.5	5.5	3.0
16.00	13.0	7.9	7.0	7.0	3.0
20.00	-	8.9	7.9	7.8	3.0
25.00	-	10.0	8.9	8.8	3.0
31.25	-	11.2	10.0	9.8	3.0
62.50	-	16.2	14.4	14.0	4.1
100.00	-	21.0	18.6	18.0	5.2
200.00	-	-	27.4	26.1	7.4
250.00	-	-	31.1	29.5	8.3
300.00	-	-	-	32.7	9.1
400.00	-	-	-	38.4	10.6
500.00	-	-	-	43.8	11.9
600.00	-	-	-	-	13.1
1000.00	-	-	-	-	17.5
1500.00	-	-	-	-	22.1
2000.00	-	-	-	-	26.2

Table 18 – Maximum permanent link insertion loss

Permanent link NEXT loss (near-end crosstalk)

Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	40.1	60.0	65.0	65.0	73.5
4.00	30.7	54.8	64.1	64.1	63.8
8.00	25.9	50.0	59.4	59.4	58.9
10.00	24.3	48.5	57.8	57.8	57.3
16.00	21.0	45.2	54.6	54.6	53.9
20.00	-	43.7	53.1	53.1	52.3
25.00	-	42.1	51.5	51.5	50.7
31.25	-	40.5	50.0	50.0	49.1
62.50	-	35.7	45.1	45.1	44.0
100.00	-	32.3	41.8	41.8	40.5
200.00	-	-	36.9	36.9	35.3
250.00	-	-	35.3	35.3	33.6
300.00	-	-	-	34.0	32.3
400.00	-	-	-	29.9	30.1
500.00	-	-	-	26.7	27.9

Table 19 - Minimum permanent link NEXT loss

Permanent link PSNEXT loss (powersum near-end crosstalk)

Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	57.0	62.0	62.0	62.0
4.00	-	51.8	61.8	61.8	60.5
8.00	-	47.0	57.0	57.0	55.6
10.00	-	45.5	55.5	55.5	54.0
16.00	-	42.2	52.2	52.2	50.6
20.00	-	40.7	50.7	50.7	49.0
25.00	-	39.1	49.1	49.1	47.3
31.25	-	37.5	47.5	47.5	45.7
62.50	-	32.7	42.7	42.7	40.6
100.00	-	29.3	39.3	39.3	37.1
200.00	-	-	34.3	34.3	31.9
250.00	-	-	32.7	32.7	30.2
300.00	-	-	-	31.4	28.8
400.00	-	-	-	27.1	26.6
500.00	-	-	-	23.8	24.8
600.00	-	-	-	-	22.6
1000.00	-	-	-	-	15.9
1500.00	-	-	-	-	10.2
2000.00	-	-	-	-	6.0

Table 20 - Minimum permanent link PSNEXT loss

Permanent link ACRF (attenuation to crosstalk ratio, far-end) or ELFEXT (equal-level far-end crosstalk)

Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	58.6	64.2	64.2	72.4
4.00	-	46.6	52.1	52.1	60.4
8.00	-	40.6	46.1	46.1	54.3
10.00	-	38.6	44.2	44.2	52.4
16.00	-	34.5	40.1	40.1	48.3
20.00	-	32.6	38.2	38.2	46.4
25.00	-	30.7	36.2	36.2	44.4
31.25	-	28.7	34.3	34.3	42.5
62.50	-	22.7	28.3	28.3	36.5
100.00	-	18.6	24.2	24.2	32.4
200.00	-	-	18.2	18.2	26.4
250.00	-	-	16.2	16.2	24.4
300.00	-	-	-	14.6	22.9
400.00	-	-	-	12.1	20.4
500.00	-	-	-	10.2	18.4
600.00	-	-	-	-	16.8
1000.00	-	-	-	-	12.4
1500.00	-	-	-	-	8.9
2000.00	-	-	-	-	6.4

Table 21 – Minimum permanent link ACRF

Permanent link PSACRF (powersum insertion loss to alien crosstalk ratio far-end) or PSELFEXT (powersum equal level far-end crosstalk)

Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	55.6	61.2	61.2	69.4
4.00	-	43.6	49.1	49.1	57.4
8.00	-	37.5	43.1	43.1	51.3
10.00	-	35.6	41.2	41.2	49.4
16.00	-	31.5	37.1	37.1	45.3
20.00	-	29.6	35.2	35.2	43.4
25.00	-	27.7	33.2	33.2	41.4
31.25	-	25.7	31.3	31.3	39.5
62.50	-	19.7	25.3	25.3	33.5
100.00	-	15.6	21.2	21.2	29.4
200.00	-	-	15.2	15.2	23.4
250.00	-	-	13.2	13.2	21.4
300.00	-	-	-	11.6	19.9
400.00	-	-	-	9.1	17.4
500.00	-	-	-	7.2	15.4
600.00	-	-	-	-	13.8
1000.00	-	-	-	-	9.4
1500.00	-	-	-	-	5.9
2000.00	-	-	-	-	3.4

Table 22 – Minimum permanent link PSACRF

Permanent link propagation delay					
Frequency (MHz)	Category 3 (ns)	Category 5e (ns)	Category 6 (ns)	Category 6A (ns)	Category 8 (ns)
1.00	521	521	521	521	142
4.00	504	504	504	504	137
8.00	500	500	500	500	136
10.00	498	498	498	498	136
16.00	496	496	496	496	135
20.00	-	495	495	495	135
25.00	-	495	495	495	135
31.25	-	494	494	494	135
62.50	-	492	492	492	134
100.00	-	491	491	491	134
200.00	-	-	490	490	134
250.00	-	-	490	490	134
300.00	-	-	-	490	134
400.00	-	-	-	490	133
500.00	-	-	-	490	133
600.00	-	-	-	-	133
1000.00	-	-	-	-	133
1500.00	-	-	-	-	133
2000.00	-	-	-	-	133

Table 23 – Maximum permanent link propagation delay

Permanent Link Propagation Delay Skew

Permanent link propagation delay skew shall be less than 44 ns for all frequencies from 1 MHz to the upper frequency limit of the Category. For field-testing channels, it is sufficient to test at 10 MHz only and permanent link propagation delay skew at 10 MHz shall not exceed 50 ns.

Permanent link PSANEXT Loss (powersum alien near-end crosstalk)					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	-	-	67.0	75.0
4.00	-	-	-	67.0	75.0
8.00	-	-	-	67.0	75.0
10.00	-	-	-	67.0	75.0
16.00	-	-	-	67.0	75.0
20.00	-	-	-	67.0	75.0
25.00	-	-	-	66.0	75.0
31.25	-	-	-	65.1	75.0
62.50	-	-	-	62.0	75.0
100.00	-	-	-	60.0	75.0
200.00	-	-	-	55.5	75.0
250.00	-	-	-	54.0	75.0
300.00	-	-	-	52.8	75.0
400.00	-	-	-	51.0	75.0
500.00	-	-	-	49.5	74.5
600.00	-	-	-	-	73.3
1000.00	-	-	-	-	70.0
1500.00	-	-	-	-	67.4
2000.00	-	-	-	-	65.5

Table 24 – Minimum permanent link PSANEXT loss

Permanent link PSAACRF (powersum insertion loss to alien crosstalk ratio far-end) or PSAELFEXT (powersum alien equal-level far-end crosstalk)					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	-	-	67.0	-
4.00	-	-	-	65.7	-
8.00	-	-	-	59.6	-
10.00	-	-	-	57.7	-
16.00	-	-	-	53.6	-
20.00	-	-	-	51.7	-
25.00	-	-	-	49.7	-
31.25	-	-	-	47.8	-
62.50	-	-	-	41.8	-
100.00	-	-	-	37.7	-
200.00	-	-	-	31.7	-
250.00	-	-	-	29.7	-
300.00	-	-	-	28.2	-
400.00	-	-	-	25.7	-
500.00	-	-	-	23.7	-
600.00	-	-	-	-	-
1000.00	-	-	-	-	-
1500.00	-	-	-	-	-
2000.00	-	-	-	-	-

Table 25 – Minimum permanent link PSAACRF loss

Horizontal Cable Transmission Performance

The following tables show the performance specifications for horizontal cable transmission performance.

Horizontal cable return loss				
Frequency (MHz)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	20.0	20.0	20.0
4.00	-	23.0	23.0	23.0
8.00	-	24.5	24.5	24.5
10.00	-	25.0	25.0	25.0
16.00	-	25.0	25.0	25.0
20.00	-	25.0	25.0	25.0
25.00	-	24.3	24.3	24.3
31.25	-	23.6	23.6	23.6
62.50	-	21.5	21.5	21.5
100.00	-	20.1	20.1	20.1
200.00	-	-	18.0	18.0
250.00	-	-	17.3	17.3
300.00	-	-	-	16.8
400.00	-	-	-	15.9
500.00	-	-	-	15.2
600.00	-	-	-	16.8
1000.00	-	-	-	14.0
1500.00	-	-	-	14.0
2000.00	-	-	-	13.1

Table 26 – Minimum horizontal cable return loss

Horizontal cable insertion loss

Frequency (MHz)	Category 3 (dB) 100m (328 ft.)	Category 5e (dB) 100m (328 ft.)	Category 6 (dB) 100m (328 ft.)	Category 6A (dB) 100m (328 ft.)	Category 8 (dB) 30m (98n ft.)
0.772	2.2	-	-	-	-
1.00	2.6	2.0	2.0	2.1	2.0
4.00	5.6	4.1	3.8	3.8	2.0
8.00	8.5	5.8	5.3	5.3	2.0
10.00	9.7	6.5	6.0	5.9	2.0
16.00	13.1	8.2	7.6	7.5	2.2
20.00	-	9.3	8.5	8.4	2.5
25.00	-	10.4	9.5	9.4	2.8
31.25	-	11.7	10.7	10.5	3.1
62.50	-	17.0	15.4	15.0	4.4
100.00	-	22.0	19.8	19.1	5.6
200.00	-	-	29.0	27.6	7.9
250.00	-	-	32.8	31.1	8.9
300.00	-	-	-	34.3	9.8
400.00	-	-	-	40.1	11.4
500.00	-	-	-	45.3	12.8
600.00	-	-	-	-	14.1
1000.00	-	-	-	-	18.6
1500.00	-	-	-	-	23.2
2000.00	-	-	-	-	27.2

Table 27 – Maximum horizontal cable insertion loss

Horizontal cable NEXT loss (near-end crosstalk)

Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
0.772	43.0	-	-	-	-
1.00	41.3	65.3	74.3	74.3	75.3
4.00	32.3	56.3	65.3	65.3	66.3
8.00	27.8	51.8	60.8	60.8	61.8
10.00	26.3	50.3	59.3	59.3	60.3
16.00	23.2	47.2	56.2	56.2	57.2
20.00	-	45.8	54.8	54.8	55.8
25.00	-	44.3	53.3	53.3	54.3
31.25	-	42.9	51.9	51.9	52.9
62.50	-	38.4	47.4	47.4	48.4
100.00	-	35.3	44.3	44.3	45.3
200.00	-	-	39.8	39.8	40.8
250.00	-	-	39.3	38.3	39.3
300.00	-	-	-	37.1	38.1
400.00	-	-	-	35.3	36.3
500.00	-	-	-	33.8	34.8
600.00	-	-	-	-	33.6
1000.00	-	-	-	-	30.3
1500.00	-	-	-	-	27.7
2000.00	-	-	-	-	25.8

Table 28 – Minimum horizontal cable NEXT loss

Horizontal cable PSNEXT loss (powersum near-end crosstalk)					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	62.3	72.3	72.3	72.3
4.00	-	53.3	63.3	63.3	63.3
8.00	-	48.8	58.8	58.8	58.8
10.00	-	47.3	57.3	57.3	57.3
16.00	-	44.2	54.2	54.2	54.2
20.00	-	42.8	52.8	52.8	52.8
25.00	-	41.3	51.3	51.3	51.3
31.25	-	39.9	49.9	49.9	49.9
62.50	-	35.4	45.4	45.4	45.4
100.00	-	32.3	42.3	42.3	42.3
200.00	-	-	37.8	37.8	37.8
250.00	-	-	36.3	36.3	36.3
300.00	-	-	-	35.1	35.1
400.00	-	-	-	33.3	33.3
500.00	-	-	-	31.8	31.8
600.00	-	-	-	-	30.6
1000.00	-	-	-	-	27.3
1500.00	-	-	-	-	24.7
2000.00	-	-	-	-	22.8

Table 29 – Minimum horizontal cable PSNEXT loss

Horizontal cable ACRF (attenuation to crosstalk ratio, far-end) or ELFEXT (equal-level far-end crosstalk)					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	63.8	67.8	67.8	75.0
4.00	-	51.8	55.8	55.8	67.0
8.00	-	45.7	49.7	49.7	60.9
10.00	-	43.8	47.8	47.8	59.0
16.00	-	39.7	43.7	43.7	54.9
20.00	-	37.8	41.8	41.8	53.0
25.00	-	35.8	39.8	39.8	51.0
31.25	-	33.9	37.9	37.9	49.1
62.50	-	27.9	31.9	31.9	43.1
100.00	-	23.8	27.8	27.8	39.0
200.00	-	-	21.8	21.8	33.0
250.00	-	-	19.8	19.8	31.0
300.00	-	-	-	18.3	29.5
400.00	-	-	-	15.8	27.0
500.00	-	-	-	13.8	25.0
600.00	-	-	-	-	23.4
1000.00	-	-	-	-	19.0
1500.00	-	-	-	-	15.5
2000.00	-	-	-	-	13.0

Table 30 – Minimum horizontal cable ACRF

Horizontal cable PSACRF (powersum insertion loss to alien crosstalk ratio far-end) or PSELFEXT (powersum equal-level far-end crosstalk)

Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	60.8	64.8	64.8	76.0
4.00	-	48.8	52.8	52.8	64.0
8.00	-	42.7	46.7	46.7	57.9
10.00	-	40.8	44.8	44.8	56.0
16.00	-	36.7	40.7	40.7	51.9
20.00	-	34.8	38.8	38.8	50.0
25.00	-	32.8	36.8	36.8	48.0
31.25	-	30.9	34.9	34.9	46.1
62.50	-	24.9	28.9	28.9	40.1
100.00	-	20.8	24.8	24.8	36.0
200.00	-	-	18.8	18.8	30.0
250.00	-	-	16.8	16.8	28.0
300.00	-	-	-	15.3	28.5
400.00	-	-	-	12.8	24.0
500.00	-	-	-	10.8	22.0
600.00	-	-	-	-	20.4
1000.00	-	-	-	-	16.0
1500.00	-	-	-	-	12.5
2000.00	-	-	-	-	10.0

Table 31 – Minimum horizontal cable PSACRF

Horizontal Cable Propagation Delay Skew

Horizontal cable propagation delay skew shall be less than 45 ns/100 m for all frequencies from 1 MHz to the upper frequency limit of the Category.

Horizontal cable propagation delay

Frequency (MHz)	Category 3 (ns/100 m)	Category 5e (ns/100 m)	Category 6 (ns/100 m)	Category 6A (ns/100 m)	Category 8 (dB) (ns/30 m)
1.00	570	570	570	570	171.0
4.00	552	552	552	552	165.5
8.00	547	547	547	547	163.9
10.00	545	545	545	545	163.5
16.00	543	543	543	543	162.8
20.00	-	542	542	542	162.5
25.00	-	541	541	541	162.2
31.25	-	540	540	540	162.0
62.50	-	539	539	539	161.4
100.00	-	538	538	538	161.1
200.00	-	-	537	537	160.8
250.00	-	-	536	536	160.6
300.00	-	-	-	536	160.6
400.00	-	-	-	536	160.6
500.00	-	-	-	536	160.6
600.00	-	-	-	-	160.3
1000.00	-	-	-	-	160.3
1500.00	-	-	-	-	160.3
2000.00	-	-	-	-	160.2

Table 32 – Maximum horizontal cable propagation delay

Horizontal cable PSANEXT loss (powersum alien near-end crosstalk)					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	-	-	67.0	80.0
4.00	-	-	-	67.0	80.0
8.00	-	-	-	67.0	80.0
10.00	-	-	-	67.0	80.0
16.00	-	-	-	67.0	80.0
20.00	-	-	-	67.0	80.0
25.00	-	-	-	67.0	80.0
31.25	-	-	-	67.0	80.0
62.50	-	-	-	65.6	80.0
100.00	-	-	-	62.5	80.0
200.00	-	-	-	58.0	80.0
250.00	-	-	-	56.5	80.0
300.00	-	-	-	55.3	80.0
400.00	-	-	-	53.5	78.5
500.00	-	-	-	52.0	77.0
600.00	-	-	-	-	75.8
1000.00	-	-	-	-	72.5
1500.00	-	-	-	-	69.9
2000.00	-	-	-	-	68.0

Table 33 – Minimum horizontal cable PSANEXT loss

Horizontal cable PSAACRF (powersum insertion loss to alien crosstalk ratio far-end) or PSAELFEXT (powersum alien equal level far-end crosstalk)					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	-	-	67.0	80.0
4.00	-	-	-	66.2	80.0
8.00	-	-	-	60.1	80.0
10.00	-	-	-	58.2	80.0
16.00	-	-	-	54.1	78.1
20.00	-	-	-	52.2	76.2
25.00	-	-	-	50.2	74.2
31.25	-	-	-	48.3	72.3
62.50	-	-	-	42.3	66.3
100.00	-	-	-	38.2	62.2
200.00	-	-	-	32.2	56.2
250.00	-	-	-	30.2	54.2
300.00	-	-	-	28.7	52.7
400.00	-	-	-	26.2	50.2
500.00	-	-	-	24.2	48.2
600.00	-	-	-	-	46.6
1000.00	-	-	-	-	42.2
1500.00	-	-	-	-	38.7
2000.00	-	-	-	-	36.2

Table 34 – Minimum horizontal cable PSAACRF loss

IEEE 10GBASE-T application support

	TIA Category 5e UTP	TIA Category 6 UTP	TIA Augmented Category 6 UTP	ISO Class E _A
Recognized by IEEE 802.3an	No	Yes	Yes	Yes
55-Meter Distance Support	No	Yes	Yes	Yes
100-Meter Distance Support	No	No	Yes	Yes
Extrapolated Test Limits for NEXT and PSNEXT to 500 MHz	No	No	No	Yes

Table 35 - IEEE 10GBASE-T application support

Note: Table 35 compares current TIA Category 6 cabling with new TIA and ISO specifications for 10 Gigabit cabling. This table summarizes the various twisted-pair cabling options and their respective 10 Gigabit performance attributes as defined by the latest standards. Category 5e is not recognized as a viable cabling media to support 10 Gigabit transmission regardless of its installed cabling distance. Category 6 cabling will only support 10 Gigabit Ethernet at a maximum installed distance of 55 meters.

Bundled and Hybrid Cable

Bundled, wrapped or hybrid cables are allowed for use in horizontal cabling, provided that each individual cable type meets the TIA-568.2-D transmission specifications and that the PSNEXT loss created by adjacent jacketed cables is 3 dB better than the normally allowed pair-to-pair NEXT for the cable type being tested. Color codes must follow individual cable standards to distinguish them from multipair twisted-pair backbone cabling.

Patch Cord Transmission Performance

Jumper and patch cord maximum length limitations:

- 20 m (66 ft.) in main cross-connect
- 20 m (66 ft.) in intermediate cross-connect
- 6 m (20 ft.) in telecommunications room
- 3 m (10 ft.) in the work area

Assembled patch cords: Insertion loss (attenuation): per 100 m (328 ft.) at 20° C = horizontal UTP cable insertion loss + 20 percent (due to stranded conductors) for all performance categories

Matrix of backward-compatible mated component performance

		Category of modular connecting hardware performance				
		Category 3	Category 5e	Category 6	Category 6A	Category 8
Modular plug and cord performance	Category 3	Category 3	Category 3	Category 3	Category 3	Category 3
	Category 5e	Category 3	Category 5e	Category 5e	Category 5e	Category 5e
	Category 6	Category 3	Category 5e	Category 6	Category 6	Category 6
	Category 6A	Category 3	Category 5e	Category 6	Category 6A	Category 6A
Category 8	Category 3	Category 5e	Category 6	Category 6A	Category 8	

Table 36 – Matrix of backward-compatible mated component performance

Table 36 illustrates that the lowest-rated component determines the rating of the permanent link or channel.

Patch Cord Cable Construction

Stranded conductors for extended flex-life cables used for patch cords and cross-connect jumpers need to be of the same performance Category (or higher) as the horizontal cables they connect.

Patch cord return loss					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	19.8	19.8	19.8	19.8
4.00	-	21.6	21.6	21.6	21.6
8.00	-	22.5	22.5	22.5	22.5
10.00	-	22.8	22.8	22.8	22.8
16.00	-	23.4	23.4	23.4	23.4
20.00	-	23.7	23.7	23.7	23.7
25.00	-	24.0	24.0	24.0	24.0
31.25	-	23.0	23.0	23.0	23.1
62.50	-	20.0	20.0	20.0	20.0
100.00	-	18.0	18.0	18.0	18.0
200.00	-	-	15.0	15.0	15.0
250.00	-	-	14.0	14.0	14.0
300.00	-	-	-	12.8	13.2
400.00	-	-	-	10.9	12.0
500.00	-	-	-	9.5	11.0
600.00	-	-	-	-	10.2
1000.00	-	-	-	-	8.0
1500.00	-	-	-	-	8.0
2000.00	-	-	-	-	8.0

Table 37 – Minimum patch cord return loss

2-Meter patch cord NEXT loss (near-end crosstalk)					
Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)	Category 8 (dB)
1.00	-	65.0	65.0	65.0	65.0
4.00	-	65.0	65.0	65.0	65.0
8.00	-	60.6	65.0	65.0	65.0
10.00	-	58.7	65.0	65.0	65.0
16.00	-	54.7	62.0	62.0	62.3
20.00	-	52.8	60.1	60.1	60.4
25.00	-	50.9	58.1	58.2	58.8
31.25	-	49.0	56.2	56.3	56.6
62.50	-	43.2	50.4	50.4	50.7
100.00	-	39.3	46.4	46.4	46.8
200.00	-	-	40.6	40.7	41.0
250.00	-	-	38.8	38.9	39.2
300.00	-	-	-	36.2	37.1
400.00	-	-	-	31.9	33.8
500.00	-	-	-	28.4	31.1
600.00	-	-	-	-	28.3
1000.00	-	-	-	-	20.3
1500.00	-	-	-	-	13.8
2000.00	-	-	-	-	9.3

Table 38 – Minimum 2-meter patch cord NEXT loss

5-Meter patch cord NEXT loss (near-end crosstalk)

Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)
1.00	-	65.0	65.0	65.0
4.00	-	64.5	65.0	65.0
8.00	-	58.6	65.0	65.0
10.00	-	56.7	64.5	64.5
16.00	-	52.8	60.5	60.5
20.00	-	50.9	58.6	58.7
25.00	-	49.1	56.8	56.8
31.25	-	47.2	54.9	54.9
62.50	-	41.6	49.2	49.2
100.00	-	37.8	45.3	45.4
200.00	-	-	39.8	39.9
250.00	-	-	38.1	38.1
300.00	-	-	-	35.9
400.00	-	-	-	32.1
500.00	-	-	-	29.0

Table 39 - Minimum 5-meter patch cord NEXT loss**10-Meter patch cord NEXT loss (near-end crosstalk)**

Frequency (MHz)	Category 3 (dB)	Category 5e (dB)	Category 6 (dB)	Category 6A (dB)
1.00	-	65.0	65.0	65.0
4.00	-	62.5	65.0	65.0
8.00	-	56.7	64.8	64.8
10.00	-	54.9	62.9	63.0
16.00	-	51.0	59.0	59.1
20.00	-	49.2	57.2	57.3
25.00	-	47.4	55.4	55.4
31.25	-	45.6	53.6	53.6
62.50	-	40.2	48.1	48.1
100.00	-	36.7	44.4	44.5
200.00	-	-	39.3	39.3
250.00	-	-	37.6	37.7
300.00	-	-	-	35.8
400.00	-	-	-	32.5
500.00	-	-	-	29.8

Table 40 - Minimum 10-meter patch cord NEXT loss

PURPOSE OF THE TIA-568.3-D STANDARD

The purpose of the TIA-568.3-D standard is to specify cable and component transmission performance requirements for premises optical fiber cabling. Although this standard is primarily intended to be used by manufacturers of optical cabling solutions, other groups such as end-users, designers and installers may also find it useful.

SECTION CONTENTS

TIA-568.3-D

Optical Fiber Cabling Components

Optical Fiber Cabling Components	54
Optical Fiber Connector	55
Color Identification	55
Optical Fiber Telecommunications Outlet Required Features.....	56
Optical Fiber Splices, Fusion or Mechanical	56
Optical Fiber Connector (Mated Pair)	56
Patch Cords.....	56

OPTICAL FIBER CABLING COMPONENTS

Optical fiber cabling transmission performance parameters				
Optical fiber and cable type ^a	Wavelength (nm)	Maximum attenuation (dB/km)	Minimum overfilled modal bandwidth-length product (MHz·km) ^b	Minimum effective modal bandwidth-length product (MHz·km) ^b
62.5/125 µm Multimode	850	3.5	200	Not required
TIA 492AAAA (OM1)	1300	1.5	500	Not required
50/125 µm Multimode	850	3.5	500	Not required
TIA 492AAB (OM2)	1300	1.5	500	Not required
850-nm Laser-optimized 50/125 µm multimode	850	3.5	1,500	2,000
TIA 492AAAC (OM3)	1300	1.5	500	Not required
Single-mode indoor-outdoor				
TIA 492CAA (OS1)	1310	0.5	-	-
TIA 492CAAB (OS2) ³	1550	0.5	-	-
Single-mode inside plant				
TIA 492CAA (OS1)	1310	1.0	-	-
TIA 492CAAB (OS2) ³	1550	1.0	-	-
Single-mode outside plant				
TIA 492CAA (OS1)	1310	0.5	-	-
TIA 492CAAB (OS2) ³	1550	0.5	-	-
NOTES				
1 - The bandwidth-length product, as measured by the fiber manufacturer, can be used to demonstrate compliance with this requirement.				
2 - The fiber designation (OM1, OM2, OM3, OS1 and OS2) corresponds to the designation of ISO/IEC 11801 or ISO/IEC 24702.				
3 - OS2 is commonly referred to as "low water peak" single-mode fiber and is characterized by having a low attenuation coefficient in the vicinity of 1383 nm.				

Table 41 - Optical fiber cable transmission performance parameters

Optical fiber bend radius

Fiber type	Bend radius
Small Inside Plant Cable (2-4 fibers)	1 in. (no load)
	2 in. (with load)
All Other Inside Plant Cable	10 x diameter (no load)
	15 x diameter (with load)
Outside Plant Cable	10 x diameter (no load)
	20 x diameter (with load)

Table 42 – Optical fiber bend radius

Outside plant cable must be water-blocked and have a minimum pull strength of 600 lb. (drop cable pull strength may be 300 lb.).

Optical Fiber Connector

No specified connector: 568 “SC” and other duplex designs may be used in addition to the MPO or MTP array connectors.

Color Identification

Unless color coding is used for some other purpose, the connector strain relief and adapter housing should be identifiable by the following colors:

- 850-nm laser-optimized 50/125 μm fiber – aqua
- 50/125 μm fiber – black
- 62.5/125 μm fiber – beige
- Single-mode fiber – blue
- Angled contact ferrule single-mode connectors – green

In addition, unless color coding is used for some other purpose, the connector plug body should be generically identified by the following colors, where possible:

- Multimode – beige, black or aqua
- Single-mode – blue
- Angled contact ferrule single-mode connectors – green

Optical Fiber Telecommunications Outlet Required Features

- Capability to terminate minimum of two fibers into 568 “SC” couplings or other duplex connection
- Means of securing fiber and maintaining minimum bend radius of 25 mm (1 in.)

Optical Fiber Splices, Fusion or Mechanical

Maximum insertion loss 0.3 dB

- Minimum return loss:
 - Multimode: 20 dB
 - Single-mode: 26 dB
 - Single-mode: 55 dB (analog CATV)

Optical Fiber Connector (Mated Pair)

- Maximum insertion loss 0.75 dB

Patch Cords

- Shall be dual fiber of the same type as the horizontal and backbone fiber
- Polarity shall be keyed duplex

PURPOSE OF THE TIA-569-D STANDARD

Telecommunication systems have an impact on almost every area within and between buildings. The complexity of telecommunications has increased and now includes voice, data, video, access control, fire and security, audio, environmental and other intelligent building controls over media that includes copper data cabling, fiber optics and various forms of wireless transmission. This standard recognizes that buildings have a long life cycle and must be designed to support dynamically changing telecommunications systems and media over the life of the building. This document standardizes on specific pathway and space design and construction practices in order to support telecommunications media and equipment within buildings. It does not standardize on the media or equipment. It provides useful information on the industry-standard design alternatives available for telecommunications pathways and spaces. It is up to the telecommunications designer to properly select among the alternatives based upon the applications being employed and the various constraints imposed.

This is a summary document that highlights portions of the key provisions of the standard.

SECTION CONTENTS

TIA-569-D


Telecommunications Pathways and Spaces

Design Considerations	60
Building Spaces	63
Temperature and Humidity Requirements	63
Common Requirements for Rooms.....	64
General and Architectural	64
Racks and Cabinets.....	65
Distributor Room (Equipment Room/Telecommunications Room).....	67
Architectural and Environmental.....	68
Entrance Room or Space.....	69
Distributor Enclosure (Formerly Telecom Enclosure).....	69
Equipment Outlet (EO)	70
Multiuser Telecommunications Outlet Assembly	71
Consolidation Point	72
Other Spaces Covered in the Standard (Not summarized in this document).....	73
Access Provider Spaces and Service Provider Spaces	73
Multi-Tenant Building Spaces	73

CONTINUES >>

Building Pathways.....	73
General	73
Types of Pathways.....	73
Areas Above Ceilings	73
Access Floor Systems.....	73
Cable Support Systems.....	73
Underfloor Duct Systems	73
Cellular Floor	74
Perimeter Raceways.....	74
Utility Columns	74
Pathway Separation from EMI Sources.....	74
Separation Between Telecommunications and Power Cables.....	74
Separation from Lighting	76
Cable Tray and Cable Runway	76
Conduit	76
Furniture	76
Other In-Floor Pathways	77
Surface Raceway	77
Vertical Pathway - Sleeves or Conduits, Slots.....	77
Annex A - Firestopping.....	78


DESIGN CONSIDERATIONS

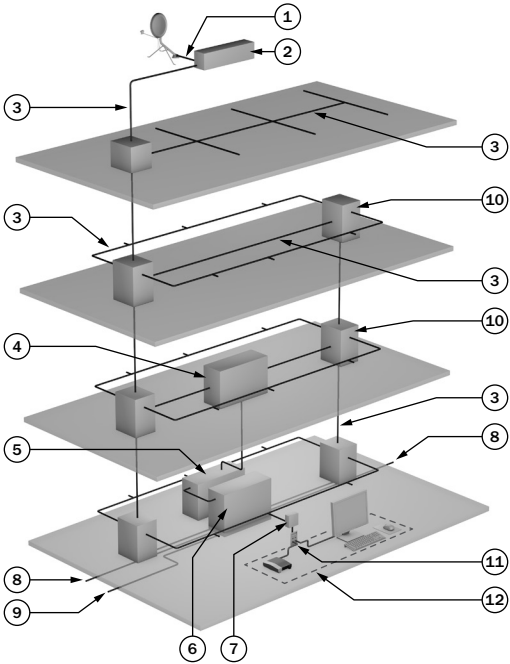

Description

- | | |
|--|---------------------------------|
| 1. Wireless service entrance pathway | 6. Entrance room |
| 2. Entrance room | 7. Distributor enclosure |
| 3. Building pathways | 8. Service entrance pathway |
| 4. Distributor room | 9. Diversity of entrance routes |
| 5. Access provider space, service provider space | 10. Distributor room |
| | 11. Equipment outlet |
| | 12. Equipment outlet location |



Figure 12 - Example of pathways and spaces in a single-tenant building

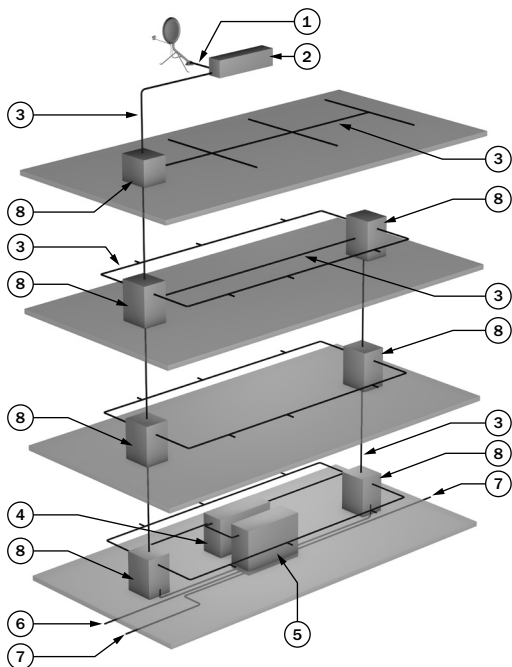

Description

- | | |
|---|---------------------------------|
| 1. Wireless service
entrance pathway | 5. Entrance room |
| 2. Entrance room | 6. Service entrance pathway |
| 3. Common building | 7. Diversity of entrance routes |
| 4. Access provider space,
service provider space | 8. Common distributor room |

Figure 13 - Example of common pathways and spaces in a multi-tenant building

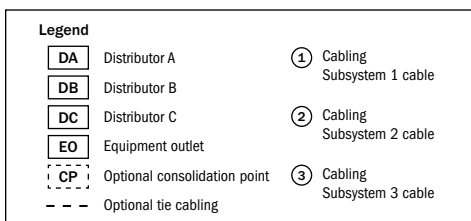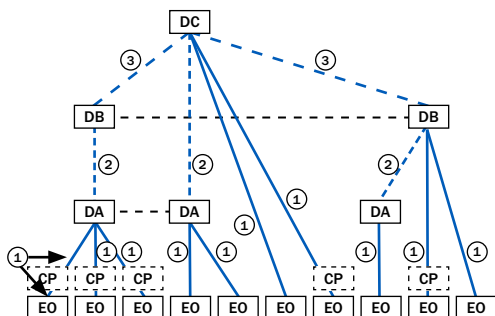

NOTE - All elements shown represent cables and connecting hardware, not spaces or pathways.

Figure 14 - Elements of generic cabling topology

BUILDING SPACES

Temperature and Humidity Requirements

ASHRAE Class	Space	Environmental requirements
Class A1	See note 1	<ul style="list-style-type: none"> Temperature: 15-32° C (59-90° F) dry bulb² Maximum rate of temperature change: 5° C (9° F) per hour in spaces where tape drives are present, otherwise 20° C (36° F) per hour Relative humidity (RH): 20-80% Maximum dew point: 17° C (63° F)
Class A2	See note 1	<ul style="list-style-type: none"> Temperature: 10-35° C (50-95° F) dry bulb² Maximum rate of temperature change: 5° C (9° F) per hour in spaces where tape drives are present, otherwise 20° C (36° F) per hour Relative humidity (RH): 20-80% Maximum dew point: 21° C (70° F)
Class A3	See note 1	<ul style="list-style-type: none"> Temperature: 5-40° C (41-104° F) dry bulb^{2,3} Maximum rate of temperature change: 5° C (9° F) per hour in spaces where tape drives are present, otherwise 20° C (36° F) per hour Relative humidity (RH): 8-85% Minimum dew point: -12° C (10° F) Maximum dew point: 24° C (75° F)
Class A4	See note 1	<ul style="list-style-type: none"> Temperature: 5-45° C (41-113° F) dry bulb^{2,3} Maximum rate of temperature change: 5° C (9° F) per hour in spaces where tape drives are present, otherwise 20° C (36° F) per hour Relative humidity (RH): 8-90% Minimum dew point: -12° C (10° F) Maximum dew point: 24° C (75° F)
Class B	Distributor room (6.4) Distributor enclosure (6.6) Entrance room or space (6.5) Access provider space (7) Service provider space (7) Common distributor room (8.2)	<ul style="list-style-type: none"> Temperature: 5-35° C (41-95° F) dry bulb³ Relative humidity (RH): 8-80% Maximum dew point: 28° C (82° F)
Class C	See note 1	<ul style="list-style-type: none"> Temperature: 5-40° C (41-104° F) dry bulb³ Relative humidity (RH): 8-80% Maximum dew point: 28° C (82° F)

Table 43 – Temperature and humidity chart

- Note:**
- Class A1, Class A2, Class A3, Class A4 and Class C are not referenced by this Standard. They are included for reference by specific premises standards.
 - Reduce maximum temperature at altitude above 950 m (3,100 ft.):
A1, A2: 1° C per 300 m (1.8° F per 1,000 ft.); A3: 1° C per 175 m (1.8° F per 575 ft.); A4: 1° C per 125 m (1.8° F per 410 ft.).
 - Minimum temperature with a diskette in a drive is 10° C (50° F).
 - The ASHRAE Thermal Guidelines for Data Processing Environments provide both recommended and allowable ranges. The requirements in this table are based on the allowable ranges.

Common Requirements for Rooms

The requirements of this section apply to the following telecommunications spaces: distributor room, common distributor room, entrance room or space, access provider space and service provider space.

General and Architectural

- Avoid selecting locations that are restricted by building components that limit expansion such as elevators, core, outside walls or other fixed building walls.
- There should be accessibility for delivery of large equipment. A minimum of one wall shall be covered with 19 mm (3/4 in.) plywood covered with two coats of fire-retardant paint.
- A minimum of one wall should be covered with 19 mm (3/4 in.) plywood. The backboard shall be 1.2 m (4 ft.) x 2.4 m (8 ft.) sheets, mounted vertically with bottom of plywood mounted 150 mm (6 in.) above the finished floor. Plywood shall be A/C grade and finished with two coats of fire-retardant paint. Plywood shall be painted prior to installation of any equipment.
- Minimum ceiling height shall be 2.4 m (8 ft.) without obstructions. The height between the finished floor and the lowest point of the ceiling should be a minimum of 3 m (10 ft.) to accommodate taller frames and overhead pathways.
- Floor loading shall be sufficient to bear all the installed loads in the building and a structural engineer consulted to do the design.
- Lighting shall be a minimum of 500 lux in the horizontal plane and 200 lux in the vertical plane measured 1 m (3 ft.) above the finished floor when occupied by personnel.
- The door shall be a minimum of 0.9 m (36 in.) wide and 2 m (80 in.) high with no doorsill, hinged to open outward (code permitting). The door shall be fitted with a lock. A double door 1.8 m (72 in.) wide by 2.3 m (90 in.) high is recommended if large equipment delivery is anticipated.

- There should be no exterior windows.
- Temperature and humidity shall meet the requirements for ASHRAE Class B in [Table 43](#).
- Environmental control such as power distribution and conditioner systems, and UPS systems, up to 100 kVA, dedicated for use by telecommunications systems in the room are permitted to be installed in the space. A UPS larger than 100 kVA must be located in a separate room.
- Equipment not related to the support of the telecommunications space (e.g., piping, ductwork, pneumatic tubing) shall not be installed in, pass through, or enter that room.
- Fire protection shall be provided per code.
- Telecom spaces shall not be located below water level, unless preventative measures are employed to prevent water infiltration. The space shall be free of water or drain pipes not directly required to support equipment in the room.

Racks and Cabinets

- Racks are equipped with fixed or adjustable side mounting rails to which equipment and hardware are mounted. Cabinets can be equipped with fixed or adjustable side mounting rails, side panels, a top, and front and rear doors, and are frequently equipped with locks.
- A minimum of 1 m (3 ft.) of clearance in front of racks and cabinets shall be provided but a 1.2 m (4 ft.) clearance is preferred. A minimum of 0.6 m (2 ft.) of rear clearance shall be provided but a clearance of 1 m (3 ft.) is preferred.
- Cabinets shall be selected and configured to provide adequate cooling for the equipment they contain. There are many cooling methods available.
- Racks and cabinets should preferably be no taller than 2.1 m (7 ft.) for easier access to the equipment or connecting hardware installed at the top. Where floor space is limited, taller racks and cabinets may be used if allowed by the Authority Having Jurisdiction (AHJ).

- Cabinets should be of adequate depth to accommodate the planned equipment to be installed, including front and rear cabling, power cords, cable management hardware and power strips. Consideration should be given to using cabinets that are at least 150 mm (6 in.) deeper or wider than the largest installed equipment.
- Cabinets should have adjustable front and rear rails, which should provide 42 or more rack mount units of space. If patch panels are installed on the front or rear of cabinets, the front or rear rails should be recessed at least 100 mm (4 in.) to allow for cable management.
- Power strips should be used with cabinets and racks that contain active electronics. Power circuits should have dedicated neutral and ground conductors. Power strips should have a locking plug but not have an on/off switch or breaker reset button to minimize accidental shut-off.
- A vertical cable manager shall be installed between each pair of racks and at both ends of every row of racks. Vertical cord managers should extend from the floor to the top of the racks. The vertical cable managers shall be not less than 83 mm (3.25 in.) in width.

Distributor Room (Equipment Room/Telecommunications Room)

The distributor room is a common access point for cabling subsystems and building pathways. It may contain telecommunications equipment, cable terminations and associated cross-connect cabling. The distributor room may also contain information technology equipment and building automation systems remote powering over structured cabling, wireless access points, distributed antenna systems, intelligent building systems and security systems. The distributor room shall be dedicated to the telecommunications function and should not be shared with electrical installations other than those used for telecommunications or related equipment. Equipment not related to the support of the distributor room (piping, ductwork, pneumatic tubing etc.) shall not be installed in or pass through this room.

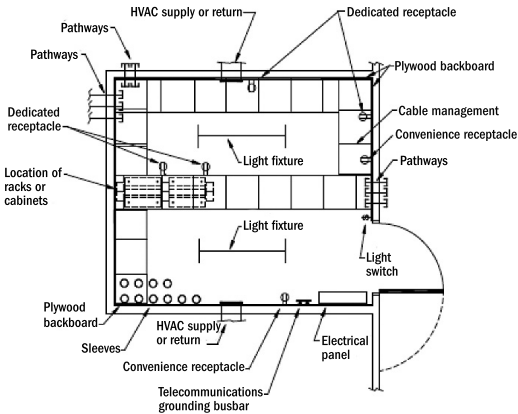


Figure 15 - Typical distributor room

Architectural and Environmental

- Locate the distributor room as close as possible to the center of the area served.
- If multiple distributor rooms are on the same floor they should be interconnected with a minimum of one trade size 3 conduit or equivalent pathway.
- Size: Minimum floor space shall be based on the number of (Distributor A) equipment outlets served directly as shown in [Table 44](#). The minimum dimension is 3 m (10 ft.) long by 3 m (10 ft.) wide. A distributor room containing Distributor B should be a minimum of 10 m² (100 ft.²). A distributor room containing Distributor C should be sized at a minimum of 11 m² (120 ft.²) for building with gross area of up to 50,000 m² (500,000 ft.²). In larger buildings the size of the distributor room containing Distributor C should be increased in increments of 1 m² (10 ft.²) for every increase of 10,000 m² (100,000 ft.²) in gross building area.
- There shall be a minimum of one distributor room per floor.
- There shall be a minimum of two dedicated 120 VAC, nonswitched, AC duplex receptacles provided, each on a separate 20 A dedicated branch circuit.
- Temperature and humidity shall be controlled to meet the requirements of [Table 43](#).
- A bonding and grounding system as specified by TIA-607-C shall be provided.

Equipment outlets served	Minimum floor space m ² (ft. ²)	Typical dimensions m (ft.)
Up to 100	9 (100)	3 x 3 (10 x 10)
101 to 200	13.5 (150)	3 x 4.5 (10 x 15)
201 to 800	36 (400)	6 x 6 (20 x 20)
801 to 1,600	72 (800)	6 x 12 (20 x 40)
1,601 to 2,400	108 (1,200)	9 x 12 (30 x 40)

Note: The minimum recommended floor spaces are calculated from the typical dimensions given.

Table 44 – Floor space

Entrance Room or Space

The entrance room is a space in which the joining of inter- or intrabuilding telecommunications facilities takes place. It is an entrance point for outside plant cabling and may contain incoming service provider cables, protectors and building cables. An entrance room may also serve as a distributor room.

- Must meet the Common Requirements for Rooms (page 60).
- Shall be located in a dry area not subject to flooding and as close as possible to the building entrance point.
- Sized to meet the present and future requirements of Distributor C.
- May be an open area or room. For buildings exceeding 2,000 m² (20,000 ft.²), an enclosed room should be provided. In buildings up to 10,000 m² (100,000 ft.²), it may be suitable to use wall-mounted termination hardware. A larger floor area may require the use of free-standing frames for terminating cables.
- A bonding and grounding system as specified in TIA-607-C shall be provided.

Distributor Enclosure (Formerly Telecom Enclosure)


A distributor enclosure is a case or housing that is designed to contain Distributor A, Distributor B or Distributor C. It is a common access point for cabling subsystems and pathways.

- It shall be located as close as possible to the center of the area served.
- It must have CEA-310E-compliant mounting holes installed or equipped with a plywood backboard to facilitate hardware mounting.
- There should be a minimum of 500 lux of light within the enclosure.
- A minimum of one dedicated 120 V/20 A nonswitched, duplex electrical outlet shall be provided.

Equipment Outlet (EO)

An equipment outlet is the outermost connection facility in a hierarchical star topology. The type of equipment outlet hardware is based on the service area it serves and the environment. In an office area, it can be a telecom outlet or a MUTOA, while in a data center the equipment outlet can be a patch panel or other connecting hardware.

- A minimum of one equipment outlet space shall be provided per area serviced. Two separate equipment outlets should be provided in areas where it may be difficult to add outlets at a later date.
- Bend radius requirements should not be violated in the space behind equipment outlets.
- Outlet boxes, if used, should be no smaller than 50 mm (2 in.) wide, 75 mm (3 in.) high, and 64 mm (2.5 in.) deep.
- If furniture is used, there are two standard sizes of openings specified:
 - Equivalent to NEMA OS 1, WD 6 openings with a minimum depth of 30.5 mm (1.2 in.)
 - Alternative furniture opening as specified in [Figure 16](#) below:



	Dimensions		Tolerance	
	mm	(in.)	mm	(in.)
L	68.8	(2.71)	1.02	(0.040)
H	35.1	(1.38)	0.90	(0.035)
T	1.4	(0.055)	0.64	(0.025)
R	4.06	(0.16) max.	-	-
C	30.5	(1.2) min.	-	-

Figure 16 – Dimensions for furniture equipment outlet opening

- For wall telephones - Flush or surface-mount outlets designed for mounting of wall telephones shall use the mounting plate shown in [Figure 17](#).



Figure 17 - Telecommunications wall outlet mounting plate

Multiuser Telecommunications Outlet Assembly (MUTOA)

MUTOAs should have appropriate security, such as key locking, tool removable covers, or other suitable means. They shall not be located under access flooring. The MUTOA shall be mounted in such a way that it does not obstruct the intended pathway cabling capacity and furniture used to house the MUTOA shall have sufficient space to allow for anticipated horizontal cable slack storage, strain relief and terminations.

Consolidation Point

Consolidation points should have appropriate security, such as key locking, tool removable covers, or other suitable means. Furniture used to house consolidation points shall have sufficient space to allow for anticipated horizontal cable slack storage, strain relief and terminations. Suspended ceiling spaces or access floors may be used, provided the space is accessible without moving building fixtures, equipment, heavy furniture or disturbing building occupants. Consolidation points in plenum spaces shall conform to applicable building codes.

OTHER SPACES COVERED IN THE STANDARD (NOT SUMMARIZED IN THIS DOCUMENT)

Access Provider Spaces and Service Provider Spaces

These spaces are used for the provider's transmission, reception and support equipment.

Multi-Tenant Building Spaces

These spaces include distributor rooms, pathways and other spaces that serve multiple tenants in a multi-tenant building.

BUILDING PATHWAYS

General

- Shall not be located in elevator shafts.
- Shall be installed in “dry” locations that protect the cables from moisture levels that are beyond the normal operating range of indoor premises cable.
- “Slab-on-grade” designs where pathways are installed underground or in concrete slabs that are in direct contact with earth are considered “wet” locations.
- Firestop should be used or maintained for all penetrations of cable, wires and pathways.

Types of Pathways

Areas Above Ceilings

May be used as pathways as well as spaces for connecting hardware.

Access Floor Systems

Consist of modular floor panels supported by pedestals and stringers.

Cable Support Systems

Cable trays and runways can be located below or above the ceiling or within an access floor system.

Underfloor Duct Systems

Pathways consisting of distribution and feeder ducts embedded in concrete containing cables for telecommunications and power services.

Cellular Floor

Generally used in steel-frame buildings in floors above grade, the steel or concrete cell sections act as the concrete floor form and later, with header ducts, act as the distribution raceways.

Perimeter Raceways

Surface-mounted pathways may contain equipment outlets and are often installed at baseboard, chair-rail or ceiling height.

Utility Columns

Extending from the ceiling to the service area, these columns provide pathways for wire and cable.

Pathway Separation from EMI Sources

Separation Between Telecommunications and Power Cables

- The requirements of the National Electrical Code (NFPA 70) shall apply.
- Zero separation distance is permitted when either the electrically conductive telecommunications cables, the power cables or both are enclosed in metallic pathways that meet the following conditions:
 - Metallic pathway(s) completely enclose the cables and are continuous.
 - Metallic pathway(s) are properly grounded and bonded per TIA-607-C.
 - Walls of the pathway(s) have a minimum thickness of 1 mm (0.04 in.) nominal if made of steel or 1.5 mm (0.06 in.) nominal if made of aluminum.
 - No separation is required between telecommunications and power cables crossing at right angles.
- [Table 45](#) (page 71) covers the guidelines for separation between balanced twisted-pair cables and adjacent power wiring. The separation distances in [Table 45](#) may be halved if the data and power cables are installed in separate solid metallic or wire mesh cable trays.

Power circuit type (sinusoidal)	Number of radial power circuits	Minimum recommended separation, mm (in.) ¹				
		E1 (EFT/B = 500 V)		E2 (EFT/B = 500 V), E3 (EFT/B = 1,000 V)		
		Unscreened power cables	Armored or screened power cables ²	Unscreened power cables		Armored or screened power cables ²
Unshielded cables	Shielded cables					
120/230 VAC, 20 A 1-phase	1	0 (0)	0 (0)	50 (2)	1 (0.04) ³	0 (0)
	2	0 (0)	0 (0)	50 (2)	5 (0.2) ³	2.5 (0.1)
	3	0 (0)	0 (0)	50 (2)	10 (0.4) ³	5 (0.2)
	4	0 (0)	0 (0)	50 (2)	12 (0.5) ³	6 (0.2)
	5-15	0 (0) ³	0 (0)	50 (2)	50 (2)	25 (1)
	16-30	100 (4)	50 (2)	100 (4)	100 (4)	50 (2)
	31-60	200 (8)	100 (4)	200 (8)	200 (8)	100 (4)
	61-90	300 (12)	150 (6)	300 (12)	300 (12)	150 (6)
	≥ 91	600 (24)	300 (12)	600 (24)	600 (24)	300 (12)
120/230 VAC, 32 A 1-phase	1	10 (0.4) ³	5 (0.2)	50 (2)	10 (0.4) ³	5 (0.2)
	2	20 (0.8) ³	10 (0.4)	50 (2)	20 (0.8) ³	10 (0.4)
	3	30 (1) ³	15 (0.6)	50 (2)	30 (1) ³	15 (0.6)
	4-5	50 (2)	25 (1)	50 (2)	50 (2)	25 (1)
	6-9	100 (4)	50 (2)	100 (4)	100 (4)	50 (2)
	10-19	200 (8)	100 (4)	200 (8)	200 (8)	100 (4)
	20-28	300 (12)	150 (6)	300 (12)	300 (12)	150 (6)
	≥ 29	600 (24)	300 (12)	600 (24)	600 (24)	300 (12)
120/230 VAC, 63 A 1-phase	1	50 (2)	25 (1)	50 (2)	50 (2)	25 (1)
	2-3	100 (4)	50 (2)	100 (4)	100 (4)	50 (2)
	4-8	200 (8)	100 (4)	200 (8)	200 (8)	100 (4)
	9-14	300 (12)	150 (6)	300 (12)	300 (12)	150 (6)
	≥ 15	600 (24)	300 (12)	600 (24)	600 (24)	300 (12)
120/230 VAC, 100 A 1-phase	1	100 (4)	50 (2)	100 (4)	100 (4)	50 (2)
	2	200 (8)	100 (4)	200 (8)	200 (8)	100 (4)
	3	300 (12)	150 (6)	300 (12)	300 (12)	150 (6)
	≥ 4	600 (24)	300 (12)	600 (24)	600 (24)	300 (12)
480 VAC, 100 A 3-phase	1	300 (12)	300 (12)	300 (12)	300 (12)	300 (12)
	≥ 2	600 (24)	600 (24)	600 (24)	600 (24)	600 (24)

Table 45 - Recommended separation from power wiring for balanced twisted-pair cabling

Note:

1. Separation distances may be halved if the power cables and data cables are installed in separate metallic pathways (see above).
2. Armoring or screening must completely surround the cable (except at the socket) and be properly bonded and grounded (earthed).
3. 50 mm (2 in.) if loose (individual) power conductors are used and not bundled or maintained close together.

Separation from Lighting

Twisted-pair cabling should be separated from fluorescent lamps and fixtures by a minimum of 125 mm (5 in.).

Cable Tray and Cable Runway

Cable trays shall be planned with an initial fill ratio of 25 percent. The maximum fill ratio of any cable tray shall be 50 percent. It should be noted that a fill ratio of 50 percent for four-pair and similar size cables will physically fill the entire tray due to spaces between cables and random placement. The maximum depth of any cable tray shall be 150 mm (6 in.). Span cable support systems should be done in accordance with the manufacturer's recommended load capacity. A support should be placed within 600 mm (24 in.) on each side of connections to a bend, tee or cross.

Noncontinuous pathway supports shall be located at intervals not to exceed 1.5 m (5 ft.). Cable shall not be laid directly on ceiling tiles or rails. Wires or rods that are already used for other functions, such as suspended ceiling grid support, shall not be used as attachment points for noncontinuous supports.

Conduit

No section of conduit shall be longer than 30 m (100 ft.) between pull points. Pull boxes shall be placed in conduit runs of over 30 m (100 ft.) and no section of conduit should have more than two 90 degree bends. The inside bend radius of a conduit 50 mm (2 in.) or less shall be at least six times the internal diameter. For conduits with an internal diameter more than 50 mm (2 in.), the inside bend radius shall be at least 10 times the internal diameter. Pull boxes should be readily accessible and should be installed in straight sections of conduit and not used in place of a bend. Conduits extending from a distributor room shall not serve more than three equipment outlet boxes.

Furniture

The maximum fill in furniture pathways is 40%. The minimum furniture pathway cross-sectional area is 950 mm (1.5 sq in.).

Other In-Floor Pathways

Other in-floor pathways such as underfloor duct systems and cellular floor are covered in detail in the main standard and are not included in this summary guide.

Surface Raceway

Surface raceway systems consist of bases, covers, associated fittings and accessories. They shall be configured as either single or multi-channel systems. The maximum pathway fill is 40%.

VERTICAL PATHWAY – SLEEVES OR CONDUITS, SLOTS

Sleeves: A minimum of five metric designator 103 (trade size 4) conduits or sleeves should be provided to service up to 4,000 m² (40,000 ft.²) of usable floor space. One additional conduit or sleeve should be provided for each additional 4,000 m² (40,000 ft.²) of usable floor space.

Slots: Slots are typically located flush against the wall within a space and should be designed at a depth (the dimension perpendicular to the wall) of 150–600 mm (6–24 in.) or narrower depths wherever possible. The size of the pathway using slots should be one slot sized at 0.04 m² (60 in.²) for up to 4,000 m² (40,000 ft.²) of usable floor space served. The slot area should be increased by 0.04 m² (60 in.²) with each 4,000 m² (40,000 ft.²) increase in usable floor space served.

A structural design engineer must approve the location and configuration of sleeves and slots.

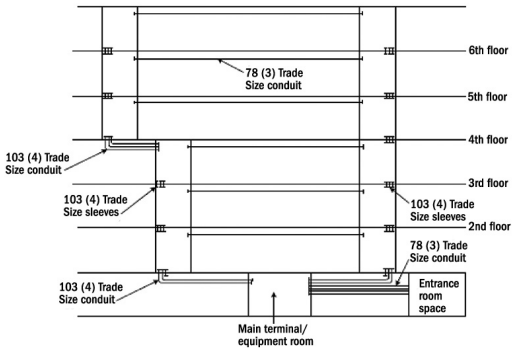


Figure 18 – Typical office building pathway layout

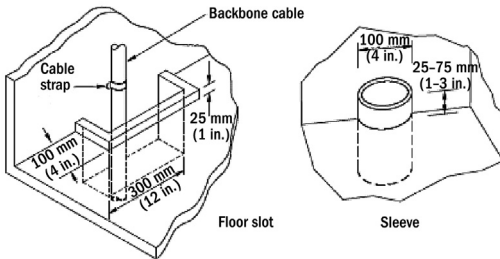


Figure 19 – Typical sleeve and slot installations

ANNEX A – FIRESTOPPING

This is a normative annex and considered part of the standard. It provides guidelines and requirements as well as methods, materials and other considerations for reestablishing the integrity of fire-rated structures such as walls, floors and ceilings when these structures are penetrated by components.

There are two broad categories of firestops:

1. Mechanical: Pre-manufactured elastomeric components shaped to fit around standard cables, tubes and conduits.
2. Non-mechanical: These come in a variety of forms that have the benefit of adapting to irregular openings and off-center penetrating items e.g., putties, caulks, cementitious materials, intumescent sheets, intumescent wrap strips, silicone foam and pre-manufactured pillows.

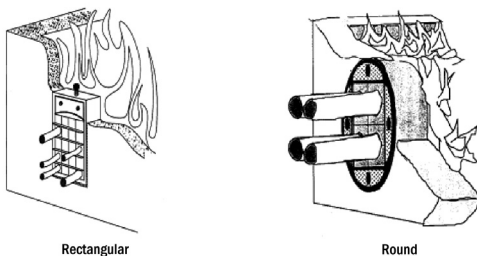


Figure 20 - Mechanical firestops

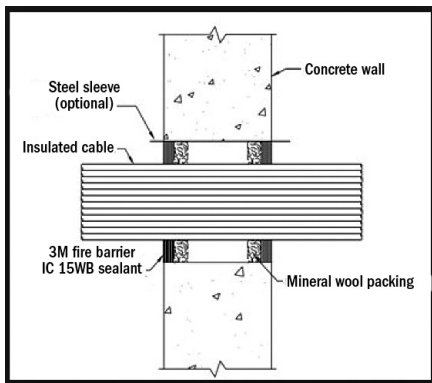


Figure 21 - Cross-section of through-wall firestop

NOTES

PURPOSE OF THE TIA-606-C STANDARD

This standard defines the “Classes of Administration” needed to properly label and administer a telecommunications infrastructure. It specifies administration for a generic telecommunications cabling system that will support a multiproduct, multimanufacturer environment.

This standard provides uniform guidelines for an administration methodology that is independent of the applications that may change over the life of the telecommunications infrastructure.

The intention of this standard is to increase the value of the infrastructure investment by reducing system maintenance expenses, extending the useful life of the system and providing effective service to users.

This standard specifies two identifier formats, one fully backward compatible with legacy TIA-606-A identifiers and one based on TIA-606-A, but modified to be compatible with the ISO/IEC TR 14763-2-1 identifiers. New administration systems should use the identifier format compatible with the ISO/IEC TR 14763-2-1.

SECTION CONTENTS

TIA-606-C

Administration Standard for Telecommunications Infrastructure

Administration Standard for Telecommunications Infrastructure	82
Elements of an Administration System	82
Scope.....	83
Classes of Administration.....	83
Compatible Formats for TIA-606-A and ISO/IEC TR 14763-2-1.....	84
Identifiers Grouped by Class – TIA-606-A Compatible.....	84
Identifiers Grouped by Class – ISO/IEC TR 14763-2-1 Compatible.....	87
Class 1 Administration	89
Class 2 Administration	90
Class 3 Administration	90
Class 4 Administration	91
Some Common Generalized Administration Labeling Guidelines	91
Color-Coding Identification	92
Permanent Labels	93
Administration Systems Using Records, Linkages and Reports	94
Automated Infrastructure Management Systems.....	95

ADMINISTRATION STANDARD FOR TELECOMMUNICATIONS STRUCTURE

Elements of an Administration System

- Cabling Subsystem 1 pathways and cabling
- Cabling Subsystem 2 and 3 pathways and cabling
- Telecommunications grounding and bonding
- Spaces (e.g., entrance facility, telecommunications room, equipment room)
- Firestopping

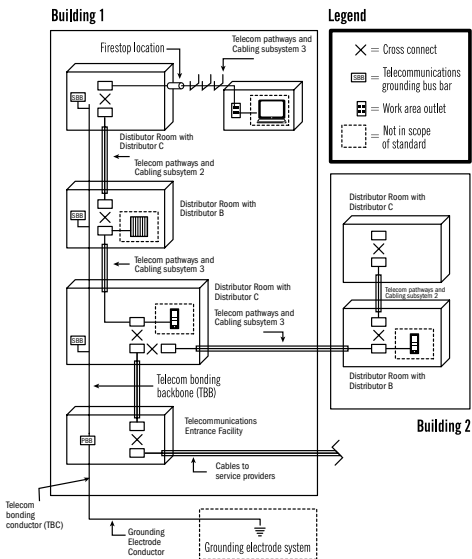


Figure 22 – A typical model for the infrastructure elements used in an administration system

Scope

This standard:

- Assigns identifiers to components in the infrastructure
- Specifies elements of information that make up records for each identifier
- Specifies relationships between records to access information they contain
- Specifies reports providing information on groups of records
- Specifies graphical and symbolic requirements.

Classes of Administration

Four classes of administration are specified in this standard to accommodate diverse degrees of complexity present in telecommunications infrastructure. Each class defines the administration requirements for identifiers, records and labeling. An administration system can be managed using a paper-based system, general-purpose spreadsheet, specialized software or automated infrastructure management (AIM) systems.

The most relevant factors in determining the minimum class of administration are the size and complexity of the infrastructure. The number of telecommunications spaces (TS), such as equipment room (ER), telecommunications room (TR), access provider spaces, service provider spaces, common distributor room, and entrance facility (EF) spaces, is one indicator of complexity.

Compatible Formats for TIA-606-A and ISO/IEC TR 14763-2-1

Two formats are specified for identifiers:

1. A format that is backward compatible with TIA-606-A
2. A format that is compatible as specified in ISO/IEC TR 14763-2-1

Note: The following two tables (Table 46 and Table 47) show the identifiers grouped by their “class” for both the TIA-606-A and the ISO/IEC TR 14763-2-1 standards. It does not provide all the individual identifier codes and formats or the specific clauses concerning each identifier that are found in the table in the master standard document. Providing such detailed information would require a voluminous amount of space and is outside the scope of this summarized Anixter Standards Reference Guide. For more in-depth information, please refer to the actual TIA-606-C document.

Identifiers Grouped by Class – TIA-606-A Compatible

Description of identifier	Class of Administration			
	1	2	3	4
Telecommunications space (TS)	R	R	R	R
Cabinet, rack, enclosure, wall segment	R	R	R	R
Patch panel or termination block	R	R	R	R
Port on patch panel or termination on termination block	R	R	R	R
Cabling Subsystem 2 or 3 (backbone) cable or cable between cabinets, racks, enclosures, or wall segments	0	R	R	R
Port within Cabling Subsystem 2 or 3 cable or cable within distributor telecommunications room, equipment room, or computer room	0	R	R	R
Cabling Subsystem 1 (horizontal) link	R	R	R	R
Equipment outlet or telecommunications outlet	0	0	0	0

Table 46 – Identifiers grouped by class – TIA-606-A compatible

Description of identifier	Class of Administration			
	1	2	3	4
Consolidation point	0	0	0	0
Port in ZDA in a data center	0	0	0	0
Space in Cabling Subsystem 1 link	0	0	0	0
TMGB - Telecommunications main grounding busbar	R	R	R	R
TGB - Telecommunications grounding busbar	R	R	R	R
RGB - Rack grounding busbar	0	0	0	0
mesh-BN - Mesh bonding network	0	0	0	0
BCT - Bonding conductor for telecommunications	R	R	R	R
TBB - Telecommunications bonding backbone	0	R	R	R
GE - Grounding equalizer	0	R	R	R
Bonding conductor from object to TMGB	R	R	R	R
Bonding conductor from object to TGB	R	R	R	R
Bonding conductor from object to mesh-BN	0	0	0	0
Bonding conductor from object to RGB	0	0	0	0
Building Cabling Subsystem 2 or 3 (backbone) cable	0	R	R	R
Building Cabling Subsystem 2 or 3 pair/port	0	R	R	R
Building Cabling Subsystem 2 or 3 cable space	0	0	0	0
Firestop location	0	R	R	R
Campus or site	0	0	0	R
Building	0	0	R	R
Interbuilding cable	0	0	R	R
Interbuilding cable pair/port	0	0	R	R
Interbuilding cable space	0	0	0	0

Table 46 – Continued

Description of identifier	Class of Administration			
	1	2	3	4
Outdoor telecommunications space (e.g., maintenance holes, handholes, pedestals, outdoor cabinets)	0	0	0	0
Intraspace pathway	0	0	0	0
Building pathway	0	0	0	0
Building entrance pathway	0	0	0	0
Outside plant pathway	0	0	0	0
Campus entrance pathway	0	0	0	0
Patch cord	0	0	0	0
Equipment cord	0	0	0	0
Direct cable between equipment	0	0	0	0

Table 46 - Continued

Notes:

R = required identifier for class, when corresponding element is present

0 = optional identifier for class

Identifiers Grouped by Class – ISO/IEC TR 14763-2-1 Compatible

Description of identifier	Class of Administration			
	1	2	3	4
Telecommunications space (TS)	R	R	R	R
Cabinet, rack, enclosure, wall segment	R	R	R	R
Patch panel or termination block	R	R	R	R
Port on patch panel or termination on termination block	R	R	R	R
Cabling Subsystem 2 or 3 (backbone) cable or cable between cabinets, racks, enclosures or wall segments	0	R	R	R
Port within Cabling Subsystem 2 or 3 cable or cable within distributor, telecommunications room, equipment room or computer room	0	R	R	R
Cabling Subsystem (horizontal) link	R	R	R	R
Equipment outlet or telecommunications outlet	0	0	0	0
Consolidation point	0	0	0	0
Port in ZDA in a data center	0	0	0	0
Space in Cabling Subsystem 1 link	0	0	0	0
TMGB - Telecommunications main grounding busbar	R	R	R	R
TGB - Telecommunications grounding busbar	R	R	R	R
RGB - Rack grounding busbar	0	0	0	0
mesh-BN - Mesh bonding network	0	0	0	0
BCT - Bonding conductor for telecommunications	R	R	R	R
TBB - Telecommunications bonding backbone	0	R	R	R
GE - Grounding equalizer	0	R	R	R
Bonding conductor from object to TMGB	0	0	0	0
Bonding conductor from object to TGB	0	0	0	0
Bonding conductor from object to mesh-BN	0	0	0	0
Bonding conductor from object to RGB	0	0	0	0

Table 47 – Identifiers grouped by class – ISO/IEC TR 14763-2-1 compatible

Description of identifier	Class of Administration			
	1	2	3	4
Building Cabling Subsystem 2 or 3 (backbone) cable	0	R	R	R
Building Cabling Subsystem 2 or 3 pair/port	0	R	R	R
Building Cabling Subsystem 2 or 3 cable space	0	0	0	0
Firestop location	0	R	R	R
Campus or site	0	0	0	R
Building	0	0	R	R
Interbuilding cable	0	0	R	R
Interbuilding cable pair/port	0	0	R	R
Interbuilding cable space	0	0	0	0
Outdoor telecommunications space (e.g. maintenance holes, handholes, pedestals, outdoor cabinets)	0	0	0	0
Intra-space pathway	0	0	0	0
Building pathway	0	0	0	0
Building entrance pathway	0	0	0	0
Outside plant pathway	0	0	0	0
Campus entrance pathway	0	0	0	0
Patch cord	0	0	0	0
Equipment cord	0	0	0	0
Direct cable between equipment	0	0	0	0

Table 47 - Continued

Notes:

R = required identifier for class, when corresponding element is present

0 = optional identifier for class

Note: [Table 46](#) and [Table 47](#) show the identifiers grouped by their “class” for both the TIA-606-A and the ISO/IEC TR 14763-2-1 standards. It does not provide all the individual identifier codes and formats or the specific clauses concerning each identifier that are found in the table in the master standard document. Providing such detailed information would require a voluminous amount of space and is outside the scope of this summarized Anixter Standards Reference Guide. For more in-depth information, please refer to the actual TIA-606-C document.

Class 1 Administration

Class 1 addresses the administration needs when only one equipment room (ER) is administered. This ER is the only telecommunications space (TS) administered and neither TRs, Cabling Subsystem 2 or 3 (backbone) cabling, or outside plant cabling is administered.

The following infrastructure identifiers shall be required in Class 1 Administration when the corresponding elements are present:

- TS (telecommunications space) identifier
- Cabinet, rack, enclosure, wall segment identifier
- Patch panel or termination block identifier
- Patch panel port and termination block position identifiers
- Identifiers for cables between cabinets, racks, enclosures, or walls in the same space
- Cabling Subsystem 1 (horizontal) link identifier
- Telecommunications main grounding busbar (TMGB) identifier
- Telecommunications grounding busbar (TGB) identifier.

Refer to [Tables 46](#) and [47](#) for Class 1 identifiers.

Class 2 Administration

Class 2 addresses the administration of infrastructure with one or more telecommunications spaces (TS) in a single building.

The following infrastructure identifiers shall be required in Class 2 Administration when the corresponding elements are present:

- Identifiers required in Class 1 Administration
- Building Cabling Subsystem 2 and 3 (backbone) cable identifiers
- Building Cabling Subsystem 2 and 3 port identifiers
- Firestopping location identifiers.

Class 2 Administration may also include pathway identifiers.

Refer to [Tables 46](#) and [47](#) for Class 2 identifiers.

Class 3 Administration

Class 3 Administration addresses infrastructure with multiple buildings at a single site.

The following infrastructure identifiers shall be required in Class 3 Administration:

- Identifiers required in Class 2 Administration
- Building identifier
- Campus cable identifier
- Campus cable pair or fiber identifier.

The following infrastructure identifiers are optional in Class 3 Administration:

- Identifiers optional in Class 2 Administration
- Outside plant pathway element identifier
- Campus pathway or element identifier.

Additional identifiers may be added if desired.

Refer to [Tables 46](#) and [47](#) for Class 3 identifiers.

Class 4 Administration

Class 4 Administration addresses infrastructure with multiple sites or campuses.

The following infrastructure identifiers shall be required in Class 4 Administration:

- Identifiers required in Class 3 Administration
- Campus or site identifier.

The following infrastructure identifiers are optional in Class 4 Administration:

- Identifiers optional in Class 3 Administration
- Intercampus element identifier.

Additional identifiers may be added if desired.

Refer to [Tables 46](#) and [47](#) for Class 4 identifiers.

Some Common Generalized Administration Labeling Guidelines

- Each telecommunications space (TS) shall be labeled with the TS identifier inside the room to be visible to someone working in the room.
- Each cabinet and rack shall be labeled with its identifier on the front and rear in plain view.
- Text on labels shall be machine printed.
- Patch panels should be labeled with their identifier and with the identifier of the patch panel at the far end.
- A unique campus or site identifier shall be assigned to each campus or site.
- A unique building identifier shall be assigned to each building.
- All ports on patch panels and all positions on terminal blocks shall be labeled.
- Cables terminated on patch panels or termination blocks shall be identified by the identifiers of the ports/terminations on both ends of the cable.

- Each intrabuilding and interbuilding cable shall be assigned with a unique identifier.
- Equipment outlets and their associated ports shall be labeled.
- The TMGB and TGB shall be labeled with their identifiers.
- All grounding conductors should be labeled with their identifiers.
- A firestopping location identifier shall identify each installation of firestopping material.
- Detailed records of all administration elements will be maintained as defined in the standard.

Color-Coding Identification

Color coding of cables, connectors, cords, jumpers, termination fields, labels, pathways and other components may be used to identify the type, application, function, or position of a component within the infrastructure.

Termination Type	Color	Pantone number	Typical application
Demarcation Point	Orange	150C	Central office connection
Network Connection	Green	353C	User side of central office connection
Common Equipment	Purple	264C	Connection to PBX, mainframe computer, LAN, multiplexer
Cabling Subsystem 3	White	N/A	Terminations of building Cabling Subsystem 3 cable connecting MC to ICs
Cabling Subsystem 2	Gray	422C	Terminations of building Cabling Subsystem 2 cable connecting IC to HCs
Campus Cabling	Brown	465C	Termination of campus cable between buildings
Cabling Subsystem 1	Blue	291C	Terminations of Cabling Subsystem 1 cable in TSs
Miscellaneous	Yellow	101C	Alarms, security or energy management

Table 48 - Example of termination field color coding

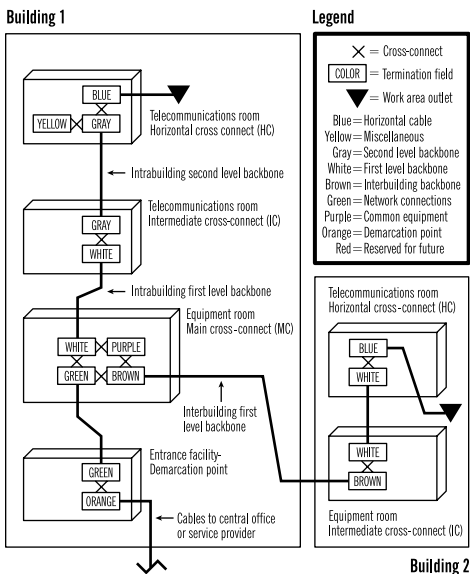


Figure 23 – Example of color coding of termination fields

Permanent Labels

- The size, color and contrast of all labels should be selected to make sure that the identifiers are easily read.
- Labels should be visible during normal maintenance of the infrastructure.
- Labels should be resistant to environmental conditions (such as moisture, heat or ultraviolet light), and should have a design life equal to or greater than that of the labeled component.
- The text on labels shall be machine generated.

Administration Systems Using Records, Linkages and Reports

Administration may be accomplished using traditional paper-based methods, spreadsheets, databases or specialized software. In addition to these systems, the functions of automated infrastructure management systems may be suitable for more complex installations, where staffing attributes make the use of automated systems more effective and efficient, and to meet regulatory compliance requirements. Generally, these systems maintain a database of all infrastructure records and may also include linkages to related records that can be used to generate reports, provide tracing functions and reduce duplication of information.

Specialized software, if used, may include standard databases and a variety of detection mechanisms to improve the accuracy and efficiency of telecommunications infrastructure administration. It may include technology to detect infrastructure changes and update records. It should be capable of generating labels or exporting the data to a device or program that will print them.

Automated Infrastructure Management Systems

Automated infrastructure management systems may be used. If used, they should:

- Automatically document the infrastructure elements as described in this standard
- Provide a comprehensive record of all the connected equipment
- Facilitate easy troubleshooting
- Provide an automated method of discovering and documenting configuration of LAN and SAN switches
- Automatically discover and document end devices that connect to the network
- Be fault tolerant (i.e., retention of information after a power outage)
- Include the capability of automatically monitoring patch connections between connections with automated management, and of generating alerts and updating documentation when any of these patch connections are changed
- Be capable of automatically generating reports about the telecommunications infrastructure.

PURPOSE OF THE TIA-607-C STANDARD

This standard specifies a uniform telecommunications grounding and bonding infrastructure that shall be followed within commercial buildings. Following the AT&T divestiture of 1984, the end-user became responsible for all premises cabling for voice and data. Advancements in voice communications and the convergence of voice and data communications led to increasingly complex interactive systems owned and maintained by the end-user. These systems require a reliable electrical ground-reference potential. Grounding by attachment to the nearest piece of iron pipe is no longer satisfactory to provide ground-reference for sophisticated active electronics systems.

SECTION CONTENTS

TIA-607-C

Generic Telecommunications Bonding and Grounding (Earthing) for Customer Premises

Overview	97
Major Components	97
Telecommunications Bonding Components	99
Busbars	99
Primary Bonding Busbar (PBB)	99
Secondary Bonding Busbar (SBB)	100
Rack Bonding Busbar (RBB)	102
Conductors	102
Telecommunications Bonding Backbone (TBB)	102
Telecommunications Bonding Conductor (TBC)	104
Backbone Bonding Conductor (BBC)	104
Coupled Bonding Conductor (CBC)	105
Telecommunications Equipment Bonding Conductor (TEBC)	105
Rack Bonding Conductors (RBC)	106
Connectors	106
Conductors	107
Labels	107
Design Requirements	108
General Rules	108
External Grounding	109

OVERVIEW

The basic principles, components and design of telecommunications bonding and grounding infrastructure specified in this standard shall be followed. Bonding and grounding systems within a building are intended to have one electrical potential.

Major Components

Within a building the generic telecommunications bonding infrastructure originates at the electrical entrance facility ground and extends throughout the building. (See Figure 24.) It includes the following major components:

- a) Primary bonding busbar (PBB);
 - b) Telecommunications bonding conductor (TBC);
- and may also include the following:
- c) Telecommunications bonding backbone (TBB);
 - d) Secondary bonding busbar (SBB); and,
 - e) Backbone bonding conductor (BBC).

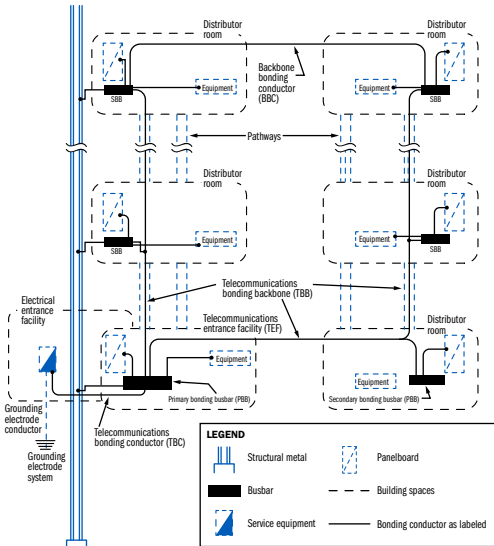


Figure 24 – Example of bonding and grounding infrastructure in a large multistory building

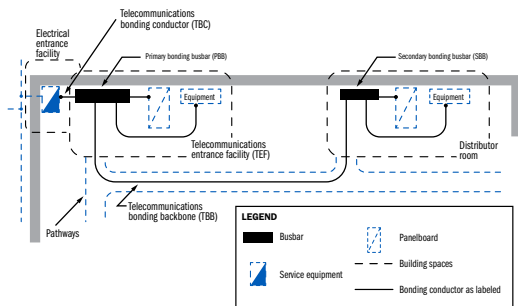


Figure 25 – Example of bonding and grounding infrastructure in a single-story large building

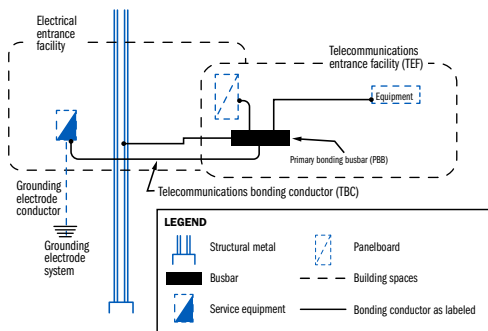


Figure 26 – Example of bonding and grounding infrastructure in a smaller building

TELECOMMUNICATIONS BONDING COMPONENTS

Busbars

Primary Bonding Busbar (PBB)

A busbar placed in a convenient and accessible location and bonded, by means of the telecommunications bonding conductor, to the building's service equipment (power) ground (formerly known as the telecommunications main grounding busbar). The PBB serves as the dedicated extension of the building grounding electrode system for the telecommunications infrastructure. It also serves as the central attachment point for the TBB(s) and equipment. A TBC bonds the PBB to the service equipment (power) ground. The desirable location of the PBB is in the telecommunications entrance room or space. Typically, there should be a single PBB per building.

The PBB shall:

- Be a busbar provided with holes for use with correctly matched listed lugs and hardware
- Be made of copper, or copper alloys having a minimum of 95% conductivity when annealed as specified by the International Annealed Copper Standard (IACS)
- Have minimum dimensions of 6.35 mm (0.25 in.) thick x 100 mm (4 in.) wide and variable in length
- Be listed
- Be cleaned and an antioxidant applied prior to fastening connectors to the busbar
- Be insulated from its support using an insulator that is listed for the purpose by a nationally recognized testing laboratory (NRTL). A minimum of 50 mm (2 in.) separation from the wall is recommended to allow access to the rear of the busbar.

More:

- The primary protector grounding conductor shall be connected to the PBB. This conductor is intended to conduct lightning and AC fault currents from the telecommunication primary protectors.

- The connections of the TBC and the telecommunications bonding backbone (TBB) to the PBB shall utilize exothermic welding, listed compression two-hole lugs, or listed exothermic two-hole lugs.

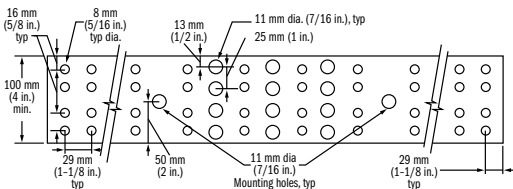


Figure 27 – Example of a primary bonding busbar (PBB). Hole spacing, pattern and size may vary.

Secondary Bonding Busbar (PBB)

A common point of connection for telecommunications system and equipment bonding to ground, and located in the distributor room (formerly known as the telecommunications grounding busbar).

The SBB is the bonding connection point for telecommunications systems and equipment in the area served by a distributor.


The SBB shall:

- Be a busbar provided with holes for use with correctly matched listed lugs and hardware
- Be a busbar provided with holes for use with correctly matched listed lugs and hardware
- Be made of copper, or copper alloys having a minimum of 95% conductivity when annealed as specified by the International Annealed Copper Standard (IACS)
- Have minimum dimensions of 6.35 mm (0.25 in.) thick x 50 mm (2 in.) wide and variable in length
- Be listed
- Be cleaned and an antioxidant applied prior to fastening connectors to the busbar

- Be insulated from its support using an insulator that is listed for the purpose by a nationally recognized testing laboratory (NRTL). A minimum of 50 mm (2 in.) separation from the wall is recommended to allow access to the rear of the busbar.

More:

- The bonding conductor between a TBB and an SBB shall be continuous and routed in the shortest practical straight-line path.
- The TBBs and other SBBs within the same space shall be bonded to the SBB with a conductor the same size as the TBB.
- Multiple SBBs within a room shall be bonded together with a conductor the same size as the TBB or with splice bars.
- All metallic pathways for telecommunications cabling located within the same room or space as the SBB shall be bonded to the SBB.
- The connection of the TBB to the SBB shall utilize exothermic welding, listed compression two-hole lugs, or listed exothermic two-hole lugs.

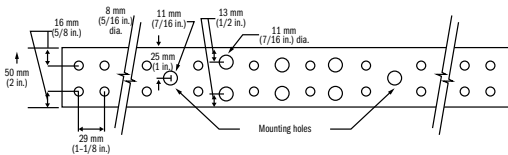

**Figure 28 – Example of a secondary bonding busbar (SBB).
Hole spacing, pattern and size may vary.**

Rack Bonding Busbar (RBB)

A rack bonding busbar is a grounding busbar within a cabinet frame or rack.

Rack bonding busbars (RBBs) are recommended for cabinets and racks that need to support multiple unit bonding conductors.

The RBB shall:

- Have a minimum cross-sectional area equal to a 6 AWG wire
- Be listed.

See [Figure 33 - Example of three methods to bond equipment and racks for diagrams of the use of bonding busbars.](#)

Conductors

A telecommunication bonding connection which interconnects telecommunications bonding backbones (formerly known as the grounding equalizer). All bonding conductors shall be copper and may be insulated. If insulated they shall be listed for the application.

Telecommunications Bonding Backbone (TBB)

A conductor that interconnects the primary bonding busbar to the secondary bonding busbar.

- Minimum TBB conductor size is 6 AWG based on the length. See [Table 49](#).
- The TBB shall bond the PBB to the service equipment (power) ground.
- TBB conductors shall be protected from physical and mechanical damage.
- The TBB conductors should be installed without splices, however, where splices are necessary, the number of splices should be minimized. Splices shall be accessible and be located in telecommunications spaces.
- Joined segments of a TBB shall be joined by means of a listed exothermic weld, listed irreversible compression-type connectors, or equivalent.

- Metallic cable shield(s) or any metal pathway for cable (e.g., conduit) shall not be used as a TBB.
- Whenever two or more TBBs are used within a multistory building, the TBBs shall be bonded together with a BBC at the top floor and at a minimum of every third floor in between.

TBB/BBC linear length m (ft.)	Conductor size (AWG)
Less than 4 (13)	6
4-6 (14-20)	4
6-8 (21-26)	3
8-10 (27-33)	2
10-13 (34-41)	1
13-16 (42-52)	1/0
16-20 (53-66)	2/0
20-26 (67-84)	3/0
26-32 (85-105)	4/0
32-38 (106-125)	250 kcmil
38-46 (126-150)	300 kcmil
46-53 (151-175)	350 kcmil
53-76 (176-250)	500 kcmil
76-91 (251-300)	600 kcmil
Greater than 91 (301)	750 kcmil

Table 49 – TBB/BCC conductor size vs. length

Telecommunications Bonding Conductor (TBC)

A conductor that interconnects the telecommunications bonding infrastructure to the building's service equipment (power) ground (formerly known as the *bonding conductor for telecommunications*).

- At a minimum the TBC shall be the same size as the largest TBB.
- The TBC shall bond the PBB to the service equipment (power) ground.

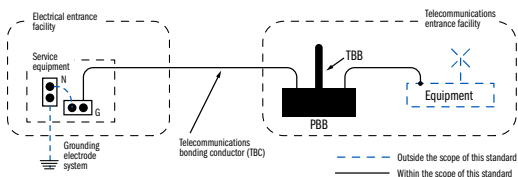


Figure 29 – Bonding to the service equipment (power) ground

Backbone Bonding Conductor (BBC)

A telecommunication bonding connection which interconnects telecommunications bonding backbones (formerly known as the *grounding equalizer*).

- At a minimum the BBC shall be the same size as the largest TBB to which it is connected.

Coupled Bonding Conductor (CBC)

CBCs provide protection against electromagnetic interference (EMI) through close proximity and may be integral to the cabling system.

The CBC:

- May be part of a cable's shield
- May be separate conductors that are tie wrapped to communications cables
- Are typically sized at 10 AWG, although 6 AWG is recommended.

Telecommunications Equipment Bonding Conductor (TEBC)

A conductor that connects the primary bonding busbar or secondary bonding busbar to equipment racks or cabinets. The TEBC connects the PBB/SBB to equipment racks/cabinets.

- More than one TEBC may be installed from the PBB/TBG (a separate TEBC per rack).
- The TEBC shall be a continuous copper conductor that is sized no smaller than a 6 AWG or as the largest size equipment grounding conductor in the AC branch power circuit(s) serving the racks/cabinet lineup.
- Connections to the TEBC shall be made with listed irreversible compression connectors, suitable for multiple conductors, and with the rack bonding conductors (RBCs) routed toward the PBB/SBB. See [Figure 29](#).
- The TEBCs may be routed within cable trays, on the outside of ladder rack, tray supported at no greater than 0.9 m (3 ft.) intervals, or along equipment platforms, see [Figure 30](#).
- TEBCs shall be separated a minimum of 50.8 mm (2 in.) from conductors of other cable groups such as power or telecommunications cables.
- The TEBC shall be connected to the cabinets/equipment racks, to an RBC or to a vertical/horizontal RBB.

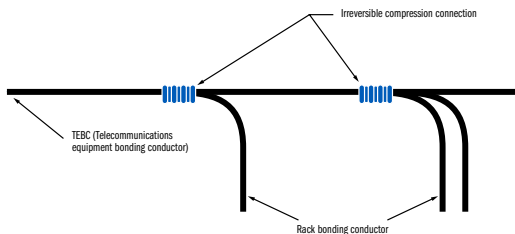


Figure 30 - Bonding to the service equipment (power) ground

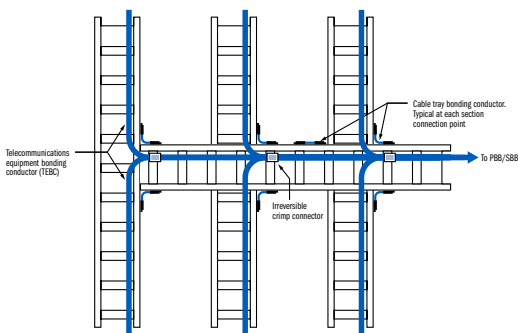


Figure 31 - Example of TEBC routed on cable tray

Rack Bonding Conductors (RBC)

Bonding conductor from the rack or rack bonding busbar to the telecommunications equipment bonding conductor.

Connectors

Connectors are the hardware that provide a means of cable termination. All bonding connectors shall be listed for the application.

Conductors

- Where insulated, the TBC, TBB, BBC, TEBC and RBC conductors shall be green, green with yellow stripe or marked with a distinctive green color.
- Bonds to structural metal shall be made using listed exothermic welding, listed compression, or listed mechanical connectors and must be accessible.
- Bonding conductors for telecommunications should not be placed in ferrous metallic conduit. If it is necessary to place bonding conductors in ferrous metallic conduit the conductors shall be bonded to each end of the conduit using a grounding bushing or using a minimum sized conductor of 6 AWG at both ends of the conduit.
- Bends of bonding conductors terminating at the PBB or SBB shall have a minimum inside bend radius of 200 mm (8 in.). At other locations, bends in bonding conductors should be made with the greatest practical inside bend radius. A minimum bend radius of 10 times the bonding conductor diameter is recommended.

Labels

Labels shall include the information described below:

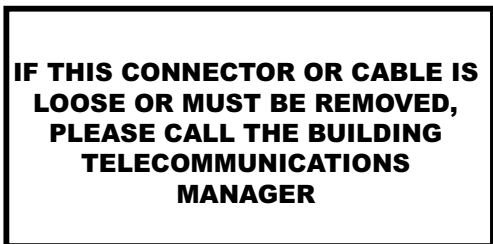


Figure 32 - Label for bonding and grounding conductors

DESIGN REQUIREMENTS

General Rules

- Metallic sheaths of outside plant cables entering a facility shall be bonded to ground as close as practical to the point of entrance.
- Where the building backbone telecommunications cabling incorporates a shield or metallic member, this shield or metallic member shall be bonded to the primary bonding busbar (PBB) or the secondary bonding busbar.
- Metallic pathways under 1 m (3 ft.) in length (e.g., wall and floor sleeves, J-hooks) are not required to be bonded.
- Each distributor room shall contain either a PBB or a minimum of one SBB. Distributor A and Distributor B shall contain a minimum of one SBB.
- Each computer room shall contain a SBB (or PBB when specified) and should also contain a supplementary bonding network that is bonded to the SBB or PBB. This supplementary bonding network is typically a mesh-bonding network (mesh-BN), which is identified in this standard but not covered in this reference guide.
- Metallic enclosures, such as telecommunications cabinets and racks, shall be bonded to the mesh-BN, SBB, or PBB using a minimum sized conductor of 6 AWG.
- Equipment containing metallic parts and patch panels for shielded cabling in cabinets and racks shall be bonded to the telecommunications bonding system. The minimum bonding conductor size is 12 AWG.
- All metallic telecommunications pathways shall be bonded to the PBB or SBB.

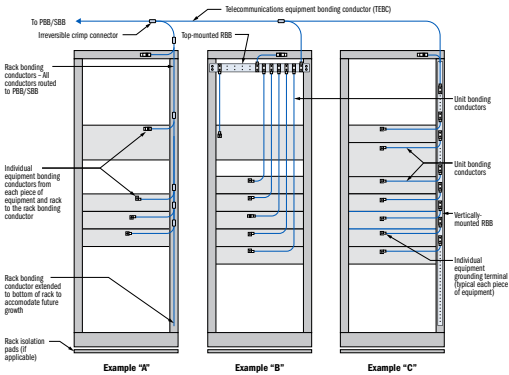


Figure 33 - Example of three methods to bond equipment and racks

External Grounding

- The grounding electrode system shall be designed to have a resistance of 25 ohms or less for a single grounding electrode.
- For sites that are critical in nature (e.g., public safety facilities, military installations, data centers, web hosting facilities, central offices) the grounding electrode system shall be designed to have a resistance of 10 ohms or less - preferably 5 ohms or less.

PURPOSE OF THE TIA-862-B STANDARD

This standard specifies the minimum requirements for a building automation system (BAS) cabling system, including the topology, architecture, design and installation practices, test procedures and components. The standard specifies cabling that is intended to support building management-related applications in a wide range of premises.

SECTION CONTENTS

TIA-862-B

Building Automation Systems Cabling Standard

Building Automation Systems Cabling Standard	112
For Commercial Buildings.....	112
Telecommunications Cabling System Structure.....	113
Cabling Subsystem 1	114
Cabling Subsystem 2 and Subsystem 3	115
Coverage Area.....	116

BUILDING AUTOMATION SYSTEMS CABLING STANDARD For Commercial Buildings

Building automation encompasses control systems such as security and monitoring (e.g., video surveillance), safety systems (e.g., fire alarms), environmental conditioning systems (e.g., heating, ventilation and air conditioning), and energy management systems (e.g., internal and external lighting). The TIA-862-B standard specifies generic cabling topology, architecture, design, installation practices, test procedures, and coverage areas to support building automation systems used in commercial buildings. Because providers of these building automation services traditionally specify their own proprietary equipment, cables, interface connections and topology, this standard offers the distinct advantage of being able to support multiproduct and multimanufacturer environments by using one generic structured cabling system.

It is important to note that this standard also supports the telecommunications cabling infrastructure for other low-voltage systems (e.g., audio and video paging, service and equipment alarms, nonvoice and data communications, and wireless access points).

The standard specifies:

- Horizontal cabling
- Backbone cabling
- Coverage area
- Spaces
- Pathways
- Administration.

Telecommunications Cabling System Structure

This standard establishes a structure for building automation system (BAS) cabling based on the generic cabling system structure in TIA-568.0-D. Figure 34 shows a typical building layout that uses a hierarchical star-wired cabling topology to support various BAS devices.

The elements of a BAS cabling system structure are listed below.

- Cabling Subsystem 1, Cabling Subsystem 2 and Cabling Subsystem 3 coverage area (space containing equipment outlets)
- Telecommunications room (TR) or common telecommunications room (CTR) (space containing Distributor A, Distributor B or Distributor C)
- Equipment room (ER) or common equipment room (CER) (space containing Distributor A, Distributor B or Distributor C)
- Mechanical room (MR)
- Entrance facilities (EF)
- Recognized horizontal and backbone cabling media meeting the requirements of TIA-568.2-D and TIA-568.3-D
- Administration

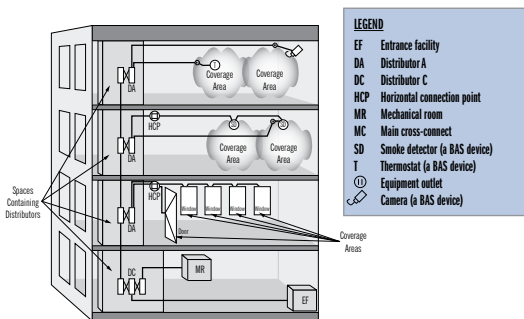


Figure 34 - TIA-862-B star-wired cabling topology

Cabling Subsystem 1

This cabling subsystem is intended to provide a structured wiring framework for the integration of common services, the diversity of BAS systems and products, redundancy and physical security requirements such as closed-circuit television (CCTV) and IP-based video. The elements of Cabling Subsystem 1 include Distributor A, Distributor B or Distributor C, the cable, horizontal connection point (HCP) and the equipment outlet as shown in [Figure 35](#).

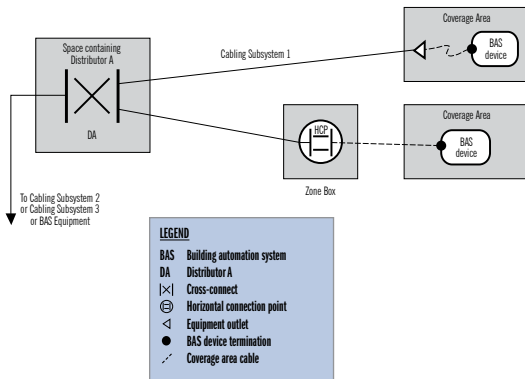


Figure 35 – Example for Cabling Subsystem 1

When planning the cabling infrastructure, the Cabling Subsystem 1 should accommodate the coverage areas specified by the standard as defined in [Table 50](#).

Cabling Subsystem 2 and Subsystem 3

Cabling Subsystem 2 and Cabling Subsystem 3 provide interconnections between the spaces that contain Distributor A, Distributor B or Distributor C, MR, terminal space and EFs that span a campus' buildings.

The estimates for the Cabling Subsystem 2 and Cabling Subsystem 3 (balanced twisted-pair and optical fiber) requirements should be based on:

- The requirements of TIA-568.0-D
- The BAS applications projected over the life expectancy of the cabling system
- The maximum number of BAS devices and electronic controllers projected over the life expectancy of the cabling system.

Coverage Area

The coverage area refers to the space that is covered by a single BAS device. The size of the coverage area is typically determined by the density of people and devices in a given area, but other factors such as physical security and BAS equipment requirements should be considered when allocating the coverage area within a building.

Usage of floor space	Coverage area (m ²) (ft ²)
Office	25 (270)
Indoor parking	50 (540)
Retail	25 (270)
Factory	50 (540)
Hotel	25 (270)
Classroom	25 (270)
Hospital	25 (270)
Mechanical room	5 (54)

Table 50 - Typical coverage area for BAS devices

In order to accommodate moves, adds and changes as well as conserve space in TRs and ERs, consider zone cabling as shown in [Figure 35](#). A single zone box can serve both BAS and telecommunications cabling; additional zone boxes can be provisioned based on:

- Accessibility
- Security
- Administration
- Special requirements.

SECTION CONTENTS

TIA-942-B

Telecommunications Infrastructure Standard for Data Centers

Telecommunications Infrastructure Standard for Data Centers	118
Data Center Cabling Infrastructure	118
Energy-Efficient Design	119
Hot and Cold Aisles	120
Horizontal Cabling.....	121
Backbone Cabling	122
Recognized Cabling Media for Horizontal and Backbone Applications...	123
Redundancy	123

TELECOMMUNICATIONS INFRASTRUCTURE STANDARD FOR DATA CENTERS

Data Center Cabling Infrastructure

The basic elements of a data center cabling topology include the following:

- Horizontal cabling
- Backbone cabling
- Cross-connect in the entrance room or main distribution area
- Main cross-connect (MC) in the main distribution area
- Horizontal cross-connect (HC) in the telecommunications room, horizontal distribution area or main distribution area
- Zone outlet or consolidation point in the zone distribution area
- Outlet in the equipment distribution area

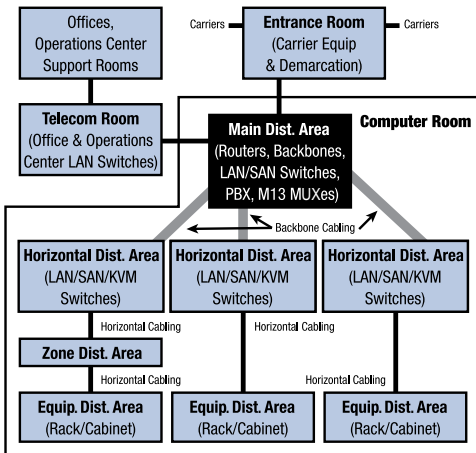


Figure 36 - Example of basic data center topology

Energy-Efficient Design

Data centers consume a disproportionate amount of energy on a square-foot basis compared to other areas of a building. The increased energy consumption is largely due to the density of computing hardware and associated power and cooling systems needed to support data center operations. Therefore, it's recommended that sustainable design practices be incorporated into the data center's design to improve power and cooling efficiency.

The following systems should be optimized to make sure that energy efficiency is achieved.

- **Telecommunications cabling:** Overhead telecommunications cabling can improve airflow in data centers by removing potential obstructions that could be present in underfloor pathways. Otherwise, cable pathways must be designed to accommodate cables that could potentially disrupt airflow and static pressure within a raised-floor environment.
- **Lighting:** It's recommended that a three-level lighting protocol be used in data centers, depending on human occupancy.
 - **Level 1:** Data center unoccupied
 - **Level 2:** Initial entry into the data center
 - **Level 3:** Occupied space
 - **Optional override:** Lighting in all zones at level 3

Hot and Cold Aisles

Cabinets and racks shall be arranged in an alternating pattern with the fronts of cabinets and racks facing each other in a row to create hot and cold aisles. Cold aisles are in front of racks and cabinets. If there is an access floor, power distribution cables should be installed here under the access floor on the slab. Hot aisles are behind racks and cabinets. If there is an access floor, cable trays for telecommunications cabling should be located under the access floor in the hot aisles.

A minimum of 1 m (3.28 ft.) of front clearance shall be provided for installation of equipment. A front clearance of 1.2 m (4 ft.) is preferable to accommodate deeper equipment. A minimum of 0.6 m (2 ft.) of rear clearance shall be provided for service access at the rear of racks and cabinets. A rear clearance of 1 m (3.28 ft.) is preferable. Some equipment may require service clearances of greater than 1 m (3.28 ft.).

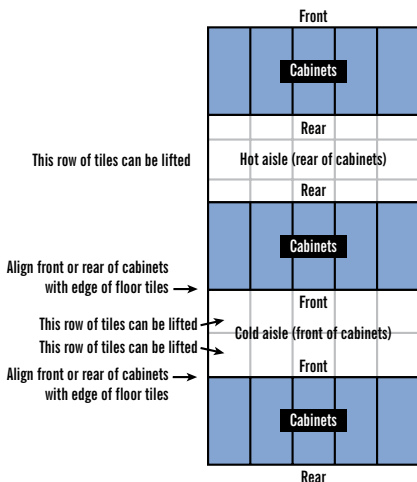


Figure 37 - Hot and cold aisles

Horizontal Cabling

The horizontal cabling is the portion of the telecommunications cabling system that extends from the mechanical termination in the equipment distribution area to either the horizontal cross-connect in the horizontal distribution area or the main cross-connect in the main distribution area. The horizontal cabling includes horizontal cables, mechanical terminations, and patch cords or jumpers. It may also include a zone outlet or a consolidation point in the zone distribution area.

The following partial listing of common services and systems should be considered when designing the horizontal cabling:

- Voice, modem and facsimile telecommunications service
- Premises switching equipment
- Computer and telecommunications management connections
- Keyboard/video/mouse (KVM) connections
- Data communications
- Wide area networks (WAN)
- Local area networks (LAN)
- Storage area networks (SAN)
- Other building signaling systems (building automation systems such as fire, security, power, HVAC, etc.)

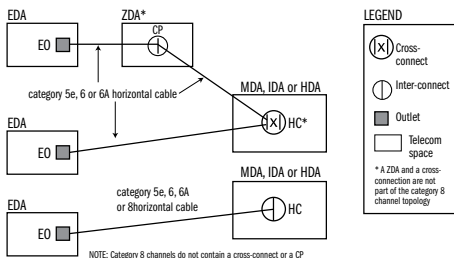


Figure 38 - Horizontal cabling using star topology

Maximum equipment area cord length

Length of horizontal cable (H) m (ft.)	24 AWG UTP/24 ScTP patch cords		26 AWG ScTP patch cords	
	Maximum length of zone area cable (Z) m (ft.)	Maximum combined length of zone area cables, patch cords and equipment (C) m (ft.)	Maximum length of zone area cable (Z) m (ft.)	Maximum combined length of zone area cables, patch cords and equipment (C) m (ft.)
90 (295)	5 (16)	10 (33)	4 (13)	8 (26)
85 (279)	9 (30)	14 (46)	7 (23)	11 (35)
80 (262)	13 (44)	18 (59)	11 (35)	15 (49)
75 (246)	17 (57)	22 (72)	14 (46)	18 (59)
70 (230)	22 (72)	27 (89)	17 (56)	21 (70)

Table 51 – Maximum length horizontal and equipment area cables

Backbone Cabling

The function of the backbone cabling is to provide connections between the main distribution area, the horizontal distribution area and entrance facilities in the data center cabling system. Backbone cabling consists of the backbone cables, main cross-connects, horizontal cross-connects, mechanical terminations and patch cord or jumpers used for backbone-to-backbone cross-connections.

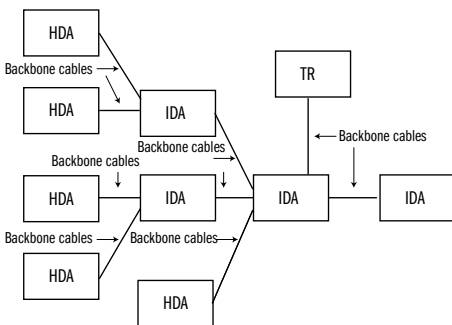


Figure 39 – Backbone cabling using star topology

Recognized Cabling Media for Horizontal and Backbone Applications

Recognized cables, associated connecting hardware, jumpers, patch cords, equipment cords and zone area cords shall meet all applicable requirements specified in TIA-568.2-D and TIA-568.3-D.

- 4-pair 100-ohm twisted-pair cable (TIA-568.2-D), Category 6 or Category 6A, or Category 8 with Category 6A or higher recommended
- 50/125 μm 850-nm laser-optimized multimode fiber cable OM3 or OM4 or OM5 (TIA-568.3-D) with OM4 or OM5 recommended
- Single-mode optical fiber cable
- Recognized coaxial media:
 - 75-ohm (734 and 735 type) coaxial cable
 - (Telcordia Technologies GR-139-CORE) and coaxial connector
 - (T1.404)

Redundancy

Data centers that are equipped with diverse telecommunications facilities may be able to continue their function under catastrophic conditions that would otherwise interrupt the data center's telecommunications service. This standard includes four tiers relating to various levels of availability of the data center facility infrastructure. The tiers are related to research conducted by the Uptime Institute, which defines four tiers of performance as shown in the following table.

In addition to the base redundancy requirements specified by the Uptime Institute tier framework, the TIA-942-B also recommends tier levels for architectural, electrical, mechanical and telecommunications systems.

From a telecommunications infrastructure redundancy perspective, providing redundant cross-connect areas and pathways that are physically separated can increase the reliability of the communications infrastructure. It is common for data centers to have multiple access providers that supply services, redundant routers, redundant core distribution and edge switches. Although this network topology provides a certain level of redundancy, the duplication in services and hardware alone does not make sure that single points of failure have been eliminated.

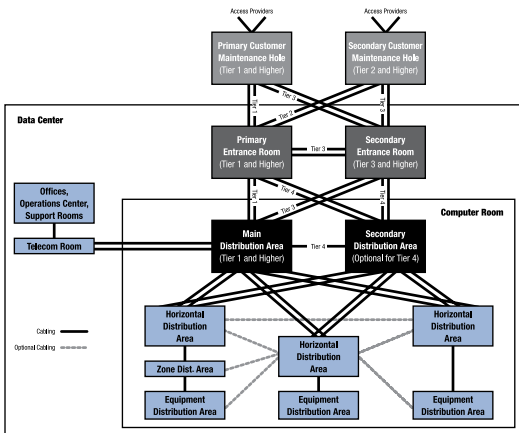


Figure 40 - Uptime Institute Tier references

PURPOSE OF THE TIA-1005-A STANDARD

This standard enables the planning and installation of the telecommunications cabling infrastructure within and between industrial buildings (such as manufacturing facilities, laboratories, refineries, etc.). In these industrial premises, the cabling infrastructure may be exposed to environments more hostile than in commercial buildings where the cabling must support applications and topologies specific to industrial premises. It provides cabling requirements, cabling distances, telecommunications outlet/connector configurations and topologies. It describes environmental classifications and provides information that is useful for designing an appropriate telecommunications infrastructure.

This is a summary document that highlights key provisions of the standard.

SECTION CONTENTS

TIA-1005-A

Telecommunications Infrastructure Standard for Industrial Premises

Telecommunications Infrastructure Standard for Industrial Premises.....	127
Elements of Generic Cabling Topology.....	127
Industrial Areas	127
General	127
Factory Floor Area	128
Work Area	128
Automation Island Area.....	128
Telecommunications Spaces	129
General Requirements	129
Telecommunications Pathways	130
General Requirements	130
Firestop.....	130

CONTINUES >>

Backbone Cabling (Cabling Subsystem 2 and 3).....	131
General Requirements	131
Recognized Media	132
Horizontal Cabling (Cabling Subsystem 1)	132
General Requirements	132
Recognized Media	133
Work Area	134
General Requirements	134
Horizontal Cables and Cords.....	135
Bonding and Grounding.....	136
General Requirements	136
Industrial Cabling and Connectors.....	138
General Requirements	138
Annex A	140
Requirements and Guidelines for 2-Pair Cabling	140
General Requirements	141

TELECOMMUNICATIONS INFRASTRUCTURE STANDARD FOR INDUSTRIAL PREMISES

Elements of Generic Cabling Topology

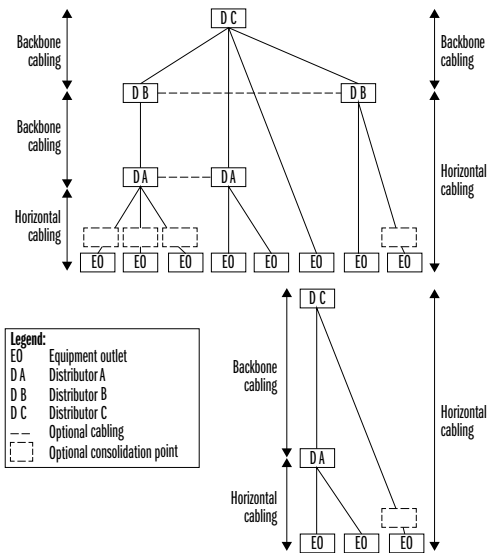


Figure 41 – Typical industrial environment

Industrial Areas

General

Industrial premises cabling may run from the front office through the factory floor area. The factory floor area (see [Figure 42](#)) may include work areas and automation island areas. Industrial premises cabling is installed in areas with a wider range of environments. These environments, that may be localized along a cabling channel, are generally expressed by “MICE” (**M** mechanical; **I** ingress; **C** climatic/chemical; and **E** electromagnetic) as described in TIA-568.0-D. The MICE environmental classification is stated with the use of subscripts ($M_a I_b C_c E_d$) where a, b, c and d are

sub-classifications. These sub-classifications are numbered 1, 2 or 3 which relate to the severity of the environmental parameter. For example, the most benign environmental classification is described as $M_1I_1C_1E_1$ whereas the harshest environmental classification is described as $M_3I_3C_3E_3$. See the TIA document TSB-185 for tutorial information on the MICE classification system.

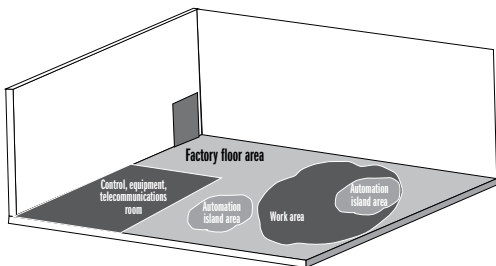


Figure 42 - Example of industrial areas

Factory Floor Area

The factory floor area is the space, beyond the office, in the manufacturing facility where work areas and automation island areas exist. These areas are typically high traffic areas that require special consideration for protection and placement of communications equipment. The environment of the factory floor area is generally classified $M_1I_1C_1E_1$ or higher.

Work Area

Work areas are those areas within a manufacturing facility where personnel interact with the telecommunications devices and industrial machines. The work area is generally in the factory floor area and in close proximity to an automation island area. Work areas often have more severe environments than the factory floor area. The environment of the work area is generally classified $M_1I_1C_1E_1$ or higher.

Automation Island Area

The automation island area is the space within the manufacturing facility in immediate proximity to or on the industrial machines

and usually associated with a work area. It is usually the most environmentally harsh area within the industrial premise. The industrial machines require connectivity to machine control devices such as machine sensors, vision and general telecommunications devices. The environment of the automation island area is generally classified higher than $M_1I_1C_1E_1$.

Telecommunications Spaces

General Requirements:

- Telecommunications spaces in industrial premises shall meet the requirements of the TIA-569-D standard.
- Temperature and humidity requirements shall meet the requirements for Class 4 in TIA-569-D, unless stated otherwise.
- Temperature and humidity inside industrial equipment enclosures shall comply with the specifications for the equipment and cabling installed in the enclosure.
- To facilitate the mounting of telecommunications equipment and components, mounting holes compliant with EIA/ECA-310-E (formerly EIA-310-D) should be installed where appropriate.
- To facilitate the mounting of industrial control equipment, mounting rails compliant with IEC 60715 (commonly referred to as DIN rails) should be installed where appropriate.
- The location for the telecommunications enclosure should be chosen based on the following considerations:
 - As close as practical to the center of the area served
 - Lowest practical MICE classification
 - Minimizing horizontal cabling length
 - Accessibility and security.
- The telecommunications enclosure shall be installed to be protected from shock and vibration as needed.

Telecommunications Pathways

General Requirements

- Pathways in industrial premises shall meet the requirements of TIA-569-D and this standard.
- Pathways should be designed to be compatible with the worst-case environment to which they will be exposed (see TIA-568.0-D for information on environmental classifications).
- Pathways in industrial premises shall comply with local codes and regulations.
- Industrial pathway requirements supersede the requirements of TIA-569-D where they are in conflict.
- Access floor systems should not be used in areas with MICE classifications more severe than M₁I₁C₁E₃.
- Cabling shall not be in direct contact with steam pipes, heating ducts or pneumatic pipes.
- Metal building structures such as I-beams and roof trusses may be used for attachment points for direct support systems that are constructed and installed in a manner that does not compromise structural integrity.
- Cabling located in open ceilings should be installed in cable tray, cable runway, or conduit, or supported.
- Cabling installed on machines shall be protected from moving machine parts and other sources of damage.
- Cabling installed on structural columns shall be properly secured and protected from mechanical damage.

Firestop

- Firestop systems in industrial premises shall meet the requirements of TIA-569-D.

Backbone Cabling (Cabling Subsystem 2 and 3)

Backbone cabling is the portion of the industrial building telecommunications cabling system that provides interconnections between entrance facilities, access provider spaces, service provider spaces, common equipment rooms, common telecommunications rooms, equipment rooms, telecommunications rooms and telecommunications enclosures.

General Requirements

- Backbone cabling shall meet the requirements of TIA-568.0-D.
- Backbone cabling shall meet the hierarchical star topology requirements of TIA-568.0-D, unless otherwise specified by this standard. (See [Figure 40](#).)
- If requirements for “bus” or “ring” or “redundancy/fault tolerant” configurations are anticipated, then cabling directly between TRs or TEs is allowed. Such cabling is in addition to the connections for the star topology specified in TIA-568.0-D.
- Cabling lengths are dependent upon the application and upon the specific media chosen (see TIA-568.0-D and the specific application standard). The backbone length includes the backbone cable, patch cords and cross-connect jumpers. Applicable balanced twisted-pair de-rating factors (see TIA-568.2-D) for cross-connect jumpers and cords shall be taken into account.
- The length of the cross-connect jumpers and patch cords in the MC or IC should not exceed 20 m (66 ft.).
- The length of the cord used to connect telecommunications equipment directly to the MC or IC should not exceed 30 m (98 ft.).

Recognized Media

The recognized media, which shall be used individually or in combination, are:

- 100 ohm balanced twisted-pair cabling (TIA-568.2-D)
- Multimode optical fiber cabling (TIA-568.3-D)
- Single-mode optical fiber cabling (TIA-568.3-D).

Horizontal Cabling (Cabling Subsystem 1)

Horizontal cabling includes horizontal cable, telecommunications outlet/connectors in the work area (WA), mechanical terminations and patch cords or jumpers located in a telecommunications room (TR) or telecommunications enclosure (TE), and may incorporate multiuser telecommunications outlet assemblies (MUTOAs) and consolidation points (CPs). In an industrial area it is possible for a single industrial cabling channel to be subjected to different static and dynamic environments. The cabling system should be designed to be compatible with its worst-case environment. Compatibility of the cabling with the environment can be achieved with enhanced cabling components or through separation or isolation. See TIA-568.0-D and TIA TSB-185 for additional information on the MICE classification system.

General Requirements

- Industrial horizontal cabling is used when the requirements are beyond TIA-568.0-D and TIA-568.1-D. For example, when the horizontal cable needs to accommodate continuous cable movement, balanced twisted pair copper cable with stranded conductor construction is allowed. If industrial horizontal cabling is used.
- Horizontal cabling topology, distances, requirements and recommendations as specified in the TIA-568.0-D standard apply unless otherwise specified in this standard.
- Each WA telecommunications outlet/connector shall be connected to the horizontal cross-connect (HC).

- The horizontal cable may be terminated either with a plug or an IDC block (balanced twisted pair) at one or both ends.
- For balanced twisted-pair cabling, the maximum permanent link length shall be 90 m (295 ft.).
- For recognized optical fiber cabling, cabling lengths are dependent upon the application and the specific media chosen (see TIA-568.0-D and Annex C of this standard and the specific application standard).
- The length of the cross-connect jumpers and patch cords in the cross-connect facilities, including HCs, jumpers and patch cords that connect horizontal cabling with equipment or backbone cabling, should not exceed 5 m (16 ft.).
- For balanced twisted-pair cabling, the total length for cords in the work area, patch cords or jumpers, and equipment cords shall not exceed 10 m (33 ft.) unless the horizontal cable length is reduced. See [Table 1](#).

Recognized Media

The recognized media, which shall be used individually or in combination are:

- 4-pair 100 ohm balanced twisted-pair cabling, Category 5e or higher (TIA-568.2-D)
- 2-pair 100 ohm balanced twisted-pair cabling
- Multimode optical fiber cabling (TIA-568.3-D), 2-fiber (or higher fiber count)
- Single-mode optical fiber cabling (TIA-568.3-D), 2-fiber (or higher fiber count).

Note – 2-pair cables may be limited in scope and may not support a full set of applications. See Annex A for further guidance on 2-pair cabling.

Cablings specified by this standard is applicable to different application requirements within the industrial premises. Choices of transmission media should be made considering the following factors:

- Environmental classifications
- Mitigation such as separation, protection or isolation
- Cabling performance enhancements in accordance with Clause 12
- Applications to be supported by the cabling system
- Equipment vendor recommendations or specifications.

Work Area

The work area (WA) components extend from the telecommunications outlet/connector end of the horizontal cabling system to the WA equipment.

General Requirements

- WA cords used in the WA shall meet the requirements of TIA-568.2-D or TIA-568.3-D.
- When application-specific adaptations are needed at the WA, they shall be external to the telecommunications outlet/connector.
- 2-pair, 100 ohm balanced twisted-pair cabling shall only be connected to the Telecommunications Outlet (TO) in the automation island area and not used between the main cross-connect and the TO in the cabling system. For additional information on 2-pair cabling, including transitioning from 4-pair to 2-pair cabling, see Annex A.

Horizontal Cables and Cords

Length of horizontal cable	22 to 24 AWG		Greater than 24 to 26 AWG	
	Maximum length of work area cord	Maximum combined length of work area cords, patch cords and equipment cord	Maximum length of work area cord	Maximum combined length of work area cords, patch cords and equipment cord
H m (ft.)	W m (ft.)	C m (ft.)	W m (ft.)	C m (ft.)
90 (295)	5 (16)	10 (33)	4 (13)	8 (26)
85 (279)	9 (30)	14 (46)	7 (24)	11 (37)
80 (262)	13 (44)	18 (60)	11 (35)	15 (48)
75 (246)	18 (57)	23 (74)	14 (46)	18 (59)
70 (229)	22 (71)	27 (87)	17 (57)	21 (70)
67 (220)	24 (79)	29 (96)	19 (63)	23 (77)
58 (190)	32 (104)	37 (120)	25 (83)	29 (96)
50 (164)	38 (126)	43 (142)	31 (101)	35 (114)
43 (141)	44 (145)	49 (161)	35 (116)	39 (129)
37 (121)	49 (161)	54 (178)	39 (129)	43 (142)
32 (105)	53 (175)	58 (191)	43 (140)	47 (153)
25 (82)	59 (194)	64 (211)	47 (155)	51 (168)
20 (66)	63 (208)	68 (224)	51 (166)	55 (179)
15 (49)	68 (221)	73 (238)	54 (177)	58 (190)
10 (33)	72 (235)	77 (252)	57 (188)	61 (201)
5 (16)	76 (249)	81 (265)	61 (199)	65 (212)
0	80 (262)	85 (279)	64 (211)	68 (223)

Table 52 – Maximum length of horizontal cables and work area cords

Bonding and Grounding

Bonding and grounding systems are an integral part of the signal or telecommunications cabling system. In addition to helping protect personnel and equipment from hazardous voltages, a proper bonding and grounding system will improve the electromagnetic compatibility performance of the cabling system. Improper bonding and grounding can produce induced voltages and conduct noise that can disrupt signal transmission.

General Requirements

- The telecommunications bonding and grounding (earthing) and system shall conform to TIA-607-C requirements.

The following guidelines can minimize the effect of multiple grounds and ground potential differences:

- a) Single-point grounds are recommended. When safety standards require the presence of multiple grounds, consider using active devices that provide a resistor and capacitor (RC) network. See [Figure 43](#) for an example implementation.

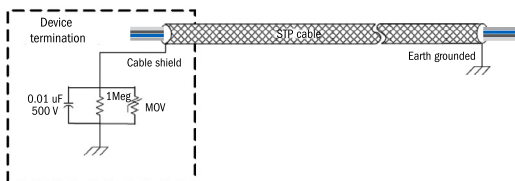


Figure 43 – Example implementation of RC grounding

- b) The use of an equipotential bonding conductor to reduce voltage offset between two grounding points or grounding systems. See [Figure 44](#) for an example implementation.

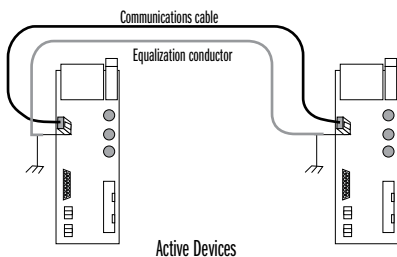


Figure 44 – Equalization conductor for active devices

c) Multiport devices:

- All bonding and grounding conductors should be as short as possible.
- Bonding and grounding conductors should be kept as close to a grounded metallic pathway as possible.
- Care should be taken when connecting multiport devices together, to avoid propagating grounds from one device to another. If it is necessary to use an equalizing conductor then it should be routed with the communications cable and both should be in a metallic pathway. Refer to TIA-607-C for additional information.

- d) The use of star grounding with the telecommunications systems can be used to mitigate ground loops in systems where equal grounding potential is not practical. See [Figure 45](#) for an example implementation.**

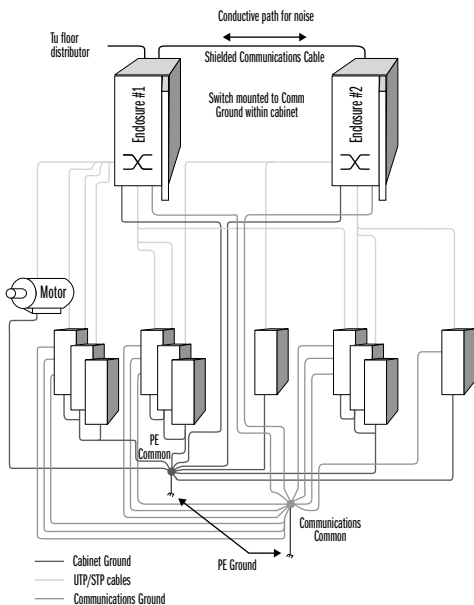


Figure 45 - Star grounding system

Industrial Cabling and Connectors


Cabling in industrial areas may require a combination of environmental compatibility (components, protection, isolation, separation) and enhanced transmission performance in order to support the intended applications.

General Requirements


- The cabling shall be designed to support the intended applications during exposure to its environmental conditions (see MICE Annex in TIA-568.0-D).
- The installed 100 ohm balanced twisted-pair channels and permanent links shall meet the performance requirements as specified in TIA-568.2-D and the additional requirements of this standard.

- 2-pair cabling shall meet the applicable transmission performance of the appropriate category as defined in TIA-568.2-D and additional requirements of this standard.
- Transverse Conversion Loss (TCL) and Equal Level Transverse Conversion Loss (ELTCL) requirements for UTP channels depend on the electromagnetic noise environment. (See MICE Table in the official TIA-568.0-D standard document). The actual TCL and ELTCL limits are determined in accordance with TIA-568.2-D, Clause 6.1.8., (for TCL) and TIA-568.2-D Clause 6.1.9. (for ELTCL).
- Optical fiber cabling shall meet the performance requirements of TIA-568.0-D and TIA-568.3-D.. Depending on the environmental conditions, additional enhancements or separation/isolation may be required.
- Connecting hardware shall conform to TIA-568.0-D, unless otherwise specified in this standard.
- When the telecommunications outlet (TO) is outside the automation island area the connectors within the TO shall be an 8-position modular connector (when balanced twisted-pair copper is used) or should be LC (when fiber media is used) and may be protected based on environmental requirements. The protection may be provided by either encapsulating the TO or the telecommunication outlet connector.
- A telecommunications outlet/connector may be housed (encapsulated) within a protective housing to provide protection from the harsh environment. The telecommunications outlet/connector may provide connectivity from one cabinet to another or from cabinet to device.
- When the TO services (into and within) the automation island area, the connectors within the TO shall be one of the following: 8-position modular connector or M12-4 D-Coding connector (when twisted-pair copper is used), or LC (when fiber media is used). The connectors shall be protected based on environmental requirements.

- 8-position modular connectors terminated using the T568A or T568B pin assignments as specified in TIA-568.0-D shall be used. The telecommunications outlet/connector shall meet the requirements of TIA-568.2-D. Category 6 or better connectors should be used.
- Where a full set of applications is not required, the M12-4 D-Coding connector as defined in IEC 61076-2-101 may be used. M12-4 D-Coding is sealed by design. This connector shall exhibit a minimum of Category 5e performance but Category 6 or better is recommended.



**M12-4 "D"
Coding Plug**



**M12-4 "D"
Coding Jack**

Figure 46 - Plug and jack side wiring M12-4 D-Coding

Annex A

Requirements and Guidelines for 2-Pair Cabling

This annex is normative and is considered part of this standard.

This annex covers requirements on the termination and mixing of generic 4-pair cabling with 2-pair cabling. 2-pair cabling is not generic and can support a limited set of services with data rates of 100Mb/s or less. Careful long-range planning should be done before selecting a cable pair count. If the infrastructure needs to support a full set of applications, then generic 4-pair cabling shall be installed.

General Requirements

Mixing 2-pair cabling in the same channel with 4-pair cabling is not recommended. When mixing 2-pair and 4-pair is necessary the following requirements and guidelines apply:

- All unused conductors of a 4-pair cabling shall be differentially terminated in accordance with the balanced cable characteristic impedance (100 ohms).
- When connecting a complete 2-pair cabling system into equipment interfaces designed for 4-pair but communicating over only two pairs (e.g. 100BASE-T), ensure that the correct pair assignment is used.
- Network switching equipment with 2-pair physical interfaces should not be connected to 4-pair cabling. Application specific to 2-pair cabling systems should be used with such equipment.
- When adapting 4-pair cabling for use with 2-pair network interface, the unused pairs of the 4-pair cabling shall be terminated in accordance with the first bullet point above.
- Unused pairs shall not be left exposed outside the connector housing.

PURPOSE OF THE TIA-1179-A STANDARD

- Enables the planning and installation of a structured cabling system for healthcare facilities and buildings
- Establishes performance and technical criteria for various cabling system configurations for accessing and connecting their respective elements.

Healthcare organizations have a diversity of services available to them and are constantly adding new services. When applying specific applications to these cabling systems, consult application standards, regulations, equipment manufacturers, system suppliers and service suppliers for applicability, limitations and ancillary requirements.

SECTION CONTENTS

TIA-1179-A

Healthcare Facility Telecommunications Infrastructure Standard

Healthcare Facility Telecommunications Infrastructure Standard	144
Telecommunications Cabling System Structure	144
Scope.....	144
Entrance Facilities.....	145
Equipment Rooms.....	145
Telecommunications Rooms and Telecommunications Enclosures	145
Backbone Cabling Subsystem (Cabling Subsystem 2 and 3)	146
Horizontal Cabling (Cabling Subsystem 1)	147
Work Area	150
Work Area Density.....	150
Multiuser Telecommunications Outlet Assemblies (MUTOAs)	153
Cabling Installation Requirements.....	153
Cabling Transmission Performance and Test Requirements.....	154

Note to the reader: This standard duplicates many, but not all, sections of the **TIA-568.0-D, .1-D, .2-D, and .3-D** standards that are already covered in this guide. In the interest of conserving space and avoiding unnecessary duplication, this summary guide will focus on highlighting the unique aspects of the **TIA-1179-A** standard that are not covered in other standards. It will reference those other standards when necessary.

HEALTHCARE FACILITY TELECOMMUNICATIONS INFRASTRUCTURE STANDARD

Telecommunications Cabling System Structure

This standard establishes a cabling system structure based on the generic cabling system structure in TIA-568.0-D (see [Figure 6](#) on page 19 in the Anixter Standards Reference Guide for TIA-568.1-D). Even though TIA-1179-A has elements that share the same name as those in TIA-568.1-D, they are not necessarily the same physical elements for the healthcare facility telecommunications system.

Scope

This standard specifies:

- The telecommunications infrastructure for healthcare facilities (e.g., hospitals and clinics)
- Cabling, cabling topologies and cabling distances
- Pathways and spaces (e.g., size and location)
- Ancillary requirements.

In addition to telecommunications systems, this standard specifies cabling that is intended to support a wide range of clinical and nonclinical systems, including:

- RFID (radio frequency identification systems)
- BAS (building automation systems)
- Nurse calls
- Security
- Access control
- Pharmaceutical inventory.

Entrance Facilities

The entrance facilities (EF) shall be designed and installed in accordance with the requirements of TIA-569-D.

The EF shall:

- Be designed with multiple entrance points and route diversity
- Be sized to accommodate other systems (e.g., building automation systems, nurse calls, security, CATV, biomedical systems) when necessary.

If the EF room size is not large enough to accommodate these other systems, they shall be installed in the equipment room (ER) or in another ER dedicated for such applications.

Functions of Entrance Facilities

- The network demarcation point between the access providers (APs) and customer premises cabling may be part of the EF. The location of this point may be determined by federal or local regulations.
- Electrical protection devices for campus backbone cables and in some cases for antennas and AP cabling may be located in the EF. Electrical codes apply for electrical protection.
- Connections between building cabling and outside plant cables via splice or other means may be included in the EF.

Equipment Rooms

- Equipment rooms shall be designed and provisioned according to the requirements in TIA-569-D.
- In many cases, an equipment room is combined with the EF and contains AP service and other premise terminations.
- Equipment rooms shall provide a minimum of two diverse pathways between the ER and EF for critical-care areas that would be severely impacted by a loss of telecommunications services. These diverse pathways shall require a route-separation distance as great as practical.

Telecommunications Rooms and Telecommunications Enclosures

- Telecommunications rooms and enclosures shall be designed in accordance with TIA-569-D.

- TRs should not have nontelecommunications services (e.g., medical gases, fluids) routed within them.
- The TR should be larger than that suitable for an office-oriented commercial building due to the numerous telecommunications services present in healthcare facilities (e.g., nurse call, patient tracking). A TR size should be 12 m² (130 ft.²) or larger.

Cross-Connections and Interconnections

Horizontal and backbone building cables shall be terminated on connecting hardware that meets the requirements of TIA-568.2-D (for balanced twisted-pair cable) or TIA-568.3-D (for optical fiber cable).

Centralized Optical Fiber Cabling

Centralized cabling shall meet the requirements of TIA-568.0-D. (See [Figure 5](#) on page 17.)

Backbone Cabling (Cabling Subsystem 2 and 3)

- The backbone cabling shall meet the requirements of TIA-568.0-D (Cabling Subsystems 2 and 3).
- It should be planned to accommodate future equipment needs, diverse user applications, ongoing maintenance, service changes, sustainability, flexibility and relocation.
- A minimum of two diverse-route backbone pathways and cables shall be provided to each TR or TE that serves critical-care areas that may be severely impacted by a loss of access-provider services. Placing cable between HCs, as shown in [Figure 6](#) on page 19, is one option that can be used to accomplish this.
- Diverse pathways should entail a route separation as great as practical.

Star Topology

Backbone cabling shall meet the hierarchical star-topology requirements of TIA-568.0-D.

- There shall be no more than two hierarchical levels of cross-connects in the backbone cabling.

Centralized Optical Fiber Cabling

Centralized optical cabling is designed as an alternative to the optical cross-connect located in the TR or TE when deploying recognized optical fiber cabling to the work area (WA) from a centralized cross-connect. (See [Figure 5](#) on page 17 in the Anixter Standards Reference Guide for TIA-568.1-D.)

Length

Cabling lengths are dependent upon the application and upon the specific media chosen (see TIA-568-C.0 and the specific application standard).

Recognized Cabling

The transmission media, which shall be used individually or in combination in backbone cabling, are as follows:

- Use 100-ohm balanced twisted-pair cabling (TIA-568.2-D); Category 6A or higher is recommended.
 - For backbone cabling, Category 3 cabling should be limited to analog voice applications.
- Multimode optical fiber cabling (TIA-568.3-D), 2-fiber (or higher) fiber count; OM4 or OM5 multimode cable recommended. Use single-mode optical fiber cabling (TIA-568.3-D), 2-fiber (or higher) fiber count.

Horizontal Cabling (Cabling Subsystem 1)

General

Horizontal cabling (See [Figure 7](#) in the Anixter Standards Reference Guide for TIA-568.1-D) includes horizontal cable, telecommunications outlet/connectors in the work area (WA), mechanical terminations and patch cords or jumpers located in a telecommunications room (TR) or telecommunications enclosure (TE), and may incorporate multiuser telecommunications outlet assemblies (MUTOAs).

- The pathways and spaces to support horizontal cabling shall be designed and installed in accordance with the requirements of TIA-569-D.

- Application-specific electrical components, such as impedance-matching devices required by some networks or services, shall not be installed as part of the horizontal cabling. When needed they will be placed external to the telecommunications outlet/connector.

For healthcare applications, the meaning of the term “work area” must be expanded to include all the connectivity required by the various applications used in a healthcare environment to provide the appropriate level of services. After the initial installation, adding or changing horizontal cabling could result in a net decrease in the quality of care being provided, which jeopardizes infection control measures or compromises life safety measures. Due to the cost and impact of making changes after the initial installation, designers need to reduce or eliminate the probability of requiring changes to the horizontal cabling as the user’s requirements evolve (e.g., by installing cabling in pathways placed between areas so the cabling is easily accessed by maintenance personnel).

- The minimum number of permanent links shall be the number required to provide the needed cabling for each type of work area. (See “Work Area” in the next section.)
- Each balanced twisted-pair cable shall be terminated in an 8-position modular jack at the equipment outlet.
- The telecommunications outlet and connector for 100-ohm balanced twisted-pair cable shall meet the requirements of TIA-568.0-D.
- Optical fibers at the equipment outlet shall be terminated to a duplex optical fiber outlet and connector meeting the requirements of TIA-568.3-D.

Topology

- The horizontal cabling shall be a star topology that meets the requirements of TIA-568.0-D.
- Each WA outlet connector shall be connected to the horizontal cross-connect (HC).

Length

The horizontal cable length extends from the termination of the media at the HC in the TR or, when used, the TE to the telecommunications outlet/connector in the work area.

The maximum length should be:

- 90 m (295 ft.) for balanced twisted-pair horizontal cabling
- 90 m (295 ft.) for optical fiber backbone cabling except for some cases where the length may be increased according to the application and upon the specific media chosen (see Annex D of TIA-568.0-D)
- 5 m (16 ft.) for cross-connect jumpers and patch cords in cross-connect facilities.

For each horizontal channel, the total length allowed for cords in the WA, plus patch cords or jumpers and equipment cords, in the TR or TE shall not exceed 10 m (33 ft.) unless a MUTOA is used.

Recognized Cabling

Three types of media are recognized and recommended for use in the horizontal cabling system:

- Use 100-ohm balanced twisted-pair cabling (TIA-568.2-D); Category 6A or higher is recommended.
- Multimode optical fiber cabling (TIA-568.3-D), 2-fiber (or higher) fiber count; OM4 or OM5 multimode cable recommended.
- Use single-mode optical fiber cabling (TIA-568.3-D), 2-fiber (or higher) fiber count.

Work Area

General

The work area (WA) components extend from the telecommunications outlet and connector end of the horizontal cabling system to the WA equipment (e.g., phone, computer, wireless access point). The telecommunications outlet and connector shall meet the requirements of TIA-568.0-D.

In healthcare applications, the work area takes on a broader scope as it is located in a multitude of application-specific areas and spaces within the healthcare facility. These areas are divided into the following classifications:

- Academics
- Patient services
- Surgery, procedure and operating rooms
- Emergency
- Ambulatory care
- Women's health
- Diagnosis and treatment
- Caregiver
- Service and support
- Facilities
- Operations
- Critical care.

Work Area Density

Table 53 shows the recommended telecommunications outlet and connector densities based on the classifications above and the function at that location. This table shows a representative list of application-specific areas found in healthcare facilities. The names and functions of the areas are not standards-based,

so they may vary by facility. Each area classification is listed with representative related spaces and each space is listed with its associated “cabling services.” The letters L, M or H refer to the relative cabling density of that work area location. If no other guidance is provided, the cabling designer should select a number between the midpoint and upper end of the range to determine the number of outlets in a particular work area location.

- L = Low:Two to six outlets in each area
- M = Medium:Six to 14 outlets in each area
- H = High: > 14 outlets in each area

A) Patient services							
Administration	Registration	Patient room	Family lounge	Waiting room	Nurses stations	Library	Consultation
M	M	H	L	L	H	M	L

B) Surgery/procedure/operating rooms							
Patient prep	Patient holding	Patient recovery	Sterile Zone	Substerile zone	Intensive care rooms	Operating room	Anesthesia offices
M	M	M	L	L	H	H	M

C) Emergency					
Ambulance bay	Evaluation	Observation	Exam rooms	Procedure rooms	
L	M	H	M	H	

D) Ambulatory care						
Procedure rooms	Outpatient surgery rooms	Mammography	Biopsy	Exam rooms	X-ray	Patient holding
M	H	M	L	M	L	L

E) Women's health				
Ultrasound	Lactation	Labor/delivery room	Infant bays	Nursery
M	H	M	L	M

F) Diagnostic and treatment					
Magnetic resonance imaging (MRI) & control room	Simulator & control room	Linear accelerator & control room	CT scanner & control room	Procedure rooms	Operating rooms
H	H	H	H	H	H
Fluoroscopy	Radiograph	X-ray	Radiation processing	Lab	
L	L	L	L		H

Table 53 - Recommended work area outlet densities

G) Caregiver				
Exam room	Clean utility	Soiled utility	Nourishment	Charting
M	M	M	L	L
Nurse station	Workroom	Galley	Read room	
H	M	L	M	

H) Service/support		
Blood bank area	Pharmacy area	Anesthesia area
M	M	H

I) Facilities				
Janitor closet	Electrical rooms	Communication/technology rooms	Building utility rooms	Elevator machine rooms
L	L	L	L	L
Mechanical rooms	Security office command center	Fire command	Specialty storage (e.g. batteries, chemicals)	
L	H	M	L	

J) Operations					
Administration	General storage	Cafeteria	Food service	Locker rooms/showers	Laundry
M	L	L	M	L	L
Central sterile	Lounge	On-call suite	Retail areas	Conference rooms	General office areas
M	L	L	L	M	L

K) Critical Care		
ICU	Neonatal ICU	Recovery
H	H	H

Table 53 - Recommended work area outlet densities (Continued)

Work Area (WA) Cords

- Cords used in the WA shall meet the performance requirements of TIA-568.2-D or TIA-568.3-D.

Multiuser Telecommunications Outlet Assemblies (MUTOAs)

MUTOAs can be used to provide flexible layouts for spaces that are frequently rearranged to meet changing requirements of the end-user.

- MUTOAs must meet the requirements of TIA-568.1-D.
- See the Section “Open Office Cabling [MUTOA]” and [Figure 8](#) in the Anixter Standards Reference Guide for TIA-568.1-D.

Maximum Work Area Cord Lengths for MUTOAs

- Balanced twisted-pair cables used in the context of MUTOAs shall meet the requirements of TIA-568.2-D.
- The maximum cord length of balanced twisted-pair WA cables used in the context of MUTOAs is as shown in [Table 6](#) in the Anixter Standards Reference Guide for TIA-568.1-D.
- Optical fiber work area cords used in the context of MUTOAs shall meet the requirements of TIA-568.3-D. The maximum horizontal cabling length is not affected by the deployment of a MUTOA.

Cabling Installation Requirements

- Installation requirements of TIA-568.0-D in addition to this standard shall be followed.
- Some locations in healthcare facilities may be sensitive to atmospheric contamination. Cabling products with specific attributes (e.g., filled or blocked cable, minimal off-gassing) may be required in these locations.
- Infection control requirements (ICR) could have a serious impact on the times and conditions for cabling installation, moves, adds and changes as well as restrictions on removing ceiling tiles, wall penetrations and access to unoccupied spaces. Prior to installation or modifications in any occupied area, the facility ICR should be consulted. Telecommunications spaces that are subject to ICR should be labeled to indicate that ICR measures may be necessary prior to entry.

- Certain cabling products from some areas of healthcare facilities may require specific and regulated means of disposal. Reusing or relocating cabling products (e.g., patch cords) from certain areas may be restricted due to infection control measures or related concerns.
- Some areas of healthcare facilities may involve high levels of electromagnetic interference (EMI). Some cable assemblies that support data transmission in these areas may require appropriate components, isolation or mitigation to comply with electromagnetic environments.
- Cabling in healthcare facilities may be exposed to high magnetic fields, radiation, high temperature, chemicals, etc. The design, installation methods and products selected should be compatible with the environment and support adequate performance during operation. The location of cabling and spaces should be selected to minimize these effects.
- Healthcare facilities make use of a number of wireless applications. It is recommended that the wireless environment be characterized and understood prior to the design, selection and installation of cabling to make sure of satisfactory operation.

Bonding and Grounding

Bonding and grounding shall meet the requirements of TIA-568.0-D. Additional information can be found in IEEE 602: “Recommended Practice for Electrical Systems in Healthcare Facilities.”

Cabling Transmission Performance and Test Requirements

The transmission performance and test requirements of TIA-568.0-D, TIA-568.2-D and TIA-1152 shall be met.

PURPOSE OF THE ISO/IEC 11801 STANDARD

This international standard provides users with an application-independent generic cabling system capable of supporting a wide range of applications. It provides users with a flexible cabling scheme, so modifications are both easy and economical. Building professionals (architects, for example) are given guidance on the accommodation of cabling at the initial stages of development.

SECTION CONTENTS

ISO/IEC 11801

Generic Cabling for Customer Premises

Generic Cabling for Customer Premises.....	156
The International Standard	156
ISO/IEC 11801 Standard	157
The Requirements for ISO (The International Organization for Standardization).....	157

GENERIC CABLING FOR CUSTOMER PREMISES

The International Standard

The International Standard specifies a multimanufacturer cabling system that may be implemented with material from single and multiple sources and is related to:

- International standards for cabling components developed by committees in the IEC
- Standards for the installation and operation of information technology cabling as well as for testing of installed cabling
- Applications developed by technical committees of the IEC
- Planning and installation guides that take into account the needs of specific applications.

Generic cabling defined within The International Standard:

- Specifies a cabling structure supporting a wide variety of applications
- Specifies channel and link classes A, B, C, D and E, meeting the requirements of standardized applications
- Specifies channel and link classes E and F based on higher performance components to support future applications
- Specifies optical channel and link classes OF-300, OF-500 and OF-2000
- Involves component requirements and specifies cabling implementations that make sure performance of permanent links and channels meet or exceed the requirements for cabling classes
- Specifies a cabling system that is anticipated to have a useful life in excess of 10 years.

ISO/IEC 11801 Standard

The Requirements for ISO (The International Organization for Standardization)

Class E_A are more demanding compared to the TIA Augmented Category 6 requirements. Anixter's Infrastructure Solutions Lab tests to the more stringent ISO standards.

ISO compared to TIA		
Characteristics 500 MHz (dB)	ISO Class E _A	TIA Augmented Category 6
PSNEXT loss	24.8 dB	23.2 dB
NEXT loss	27.9 dB	26.1 dB
PSANEXT loss	49.5 dB	49.5 dB
Return loss	6.0 dB	6.0 dB
Insertion loss	49.3 dB	49.3 dB
Referred to by IEEE	Yes	No

Table 54 - ISO/IEC Class E_A and TIA Category 6/6A performance comparison


TIA Category 6 versus Augmented Category 6/6A versus ISO Class E _A				
	TIA Category 5e	TIA Category 6	TIA Augmented 6	ISO Class E _A
Recognized by IEEE 802.3an	No	Yes	Yes	Yes
55-Meter distance support	No	Yes	Yes	Yes
100-Meter distance support	No	No	Yes	Yes
Extrapolated test limits for NEXT and PSNEXT to 500 MHz	No	No	No	Yes

Table 55 - ISO and TIA 10GBASE-T media types

Table 55 summarizes the various UTP cabling options and their respective 10 Gigabit performance attributes as defined by the latest draft standards. Category 5e is not recognized as a viable cabling media to support 10 Gigabit transmission regardless of its installed cabling distance. Category 6 cabling will only support 10 Gigabit at a maximum installed distance of 55 meters.

Today, the only options for operating 10 Gigabit at 100 meters using RJ45 connectivity are the TIA Augmented Category 6 and ISO/IEC Class E_A standards. The ISO/IEC Class E_A system has superior NEXT and PSNEXT performance values when compared with the current TIA Augmented Category 6 standard.

ANIXTER

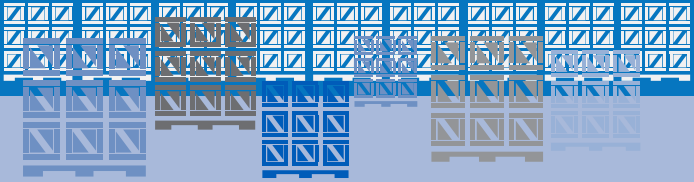

**YOU GET
MORE
WITH ANIXTER**

More Reliability

No one knows what the future holds, especially if you're a company with a 10-year-long project constructing a campus with 15 buildings and an amphitheater.

However, one such company has benefited from a reliable and trusted product and service source by partnering with us for the long haul. We provide wireless, network infrastructure and surveillance products to them in large volumes to lower their costs. And we've synced our services with their schedule which has resulted in fewer returns and faster service.

Learn what we can do for you.
anixter.com/getmore

PURPOSE OF THE IEEE 802.3 STANDARDS

This family of standards covers networking standards and recommended practices for wired and wireless, local, metropolitan and other area networks.

SECTION CONTENTS

IEEE 802.3 Standards

IEEE 802.3 Standards.....	160
IEEE 802.3af - Power over Ethernet (PoE) Standard	160
IEEE 802.3at - Power over Ethernet+ (Plus) Standard.....	160
IEEE 802.3bt 4-Pair Power Over Ethernet (4PPoE) Standard	160
IEEE 802.3an - Physical Layer and Management Parameters for 10 Gbps Operation Type 10GBASE-T	161
IEEE 802.3ba - Media Access Control Parameters, Physical Layers and Management Parameters for 40 Gbps and 100 Gbps Operation	162
IEEE 802.11 - Wireless Standard	163

IEEE 802.3 STANDARDS

IEEE 802.3af

Power over Ethernet (PoE) Standard

The IEEE 802.3af specification calls for power source equipment (PSE) that operates at 48 volts of direct current. This guarantees 12.95 watts of power over unshielded twisted-pair cable to data terminal equipment (DTE) 100 meters away (the maximum distance supported by Ethernet). That's enough power to support IP phones, WLAN access points and many other DTE devices. Two PSE types are supported including Ethernet switches equipped with power supply modules called endspan devices and a special patch panel called a midspan device that sits between a legacy switch and powered equipment, injecting power to each connection.

IEEE 802.3at

Power over Ethernet+ (Plus) Standard

The IEEE 802.3at Power over Ethernet Plus amendment to the IEEE 802.3af standard offers improved power-management features and increases the amount of power to end devices. The amendment allows for the powering devices through standard Category 5e, 6 and 6A cabling. It allows many more devices, such as access control and video surveillance, to receive power over a twisted-pair cabling infrastructure.

The standard defines the technology for powering a wide range of devices up to 25 watts over existing Category 5e and above cables. The 802.3at standard states that 30 watts at a minimum are allocated at the port, so 24.6 watts are provided at the end-device connector 100 meters away. It also allows for gigabit pass-through.

IEEE 802.3bt

4-Pair Power over Ethernet (4PPoE)

The maximum Powered Device (PD) power available is increased to 71 watts by utilizing all four pairs in the specified structured wiring plant. This represents a substantial change to the capabilities of Ethernet with standardized power. The power classification information exchanged during negotiation is extended to allow meaningful power management capability. These enhancements solve the problem of higher power and more efficient standardized Power over Ethernet (PoE) delivery systems.

IEEE 802.3an

Physical Layer and Management Parameters for 10 Gbps Operation Type 10GBASE-T

Describes the physical layer (PHY) for 10 Gigabit Ethernet transmission over twisted-pair copper cable.

IEEE 802.3an standard		
Standard	Media	Distance
ISO Class F (individual shields)	S/FTP	100 m
ISO Class E _A	UTP	100 m
TIA Augmented Category 6	UTP	100 m
Shielded Category 6 (overall shield)	F/UTP, ScTP, STP	100 m
TIA Standard Category 6/ISO Class E	UTP	<55 m

Table 56 - Maximum 10GBASE-T cabling distances

TIA-568.2-D (Augmented Category 6) and ISO/IEC 11801 Class E_A cable specifications are based on IEEE cabling models. 100 meters over UTP is only guaranteed when using Augmented Category 6 or ISO/IEC Class E_A-compliant cabling systems.

IEEE 802.3bm

Physical Layer specifications and management parameters for 40 Gbps operation over single-mode fiber (40GBASE-ER4) and for 100 Gbps operation over multimode fiber (100GBASE-SR4) are added by this amendment. This amendment also specifies a four-lane variant of the 100 Gigabit Attachment Unit Interface (CAUI-4) and optional Energy Efficient Ethernet (EEE) for 40 Gb/s and 100 Gb/s operation over fiber optic cables.

IEEE 802.3bq

This amendment to IEEE Std 802.3-2015 specifies new Physical Coding Sublayer (PCS) interfaces and new Physical Medium Attachment (PMA) sublayer interfaces for 25 Gbps Ethernet and 40 Gbps Ethernet. 25GBASE-T and 40GBASE-T specify LAN interconnects for up to 30 m of balanced twisted-pair structured cabling, for 25 Gbps and 40 Gbps, respectively.

IEEE 802.3bz

Ethernet Media Access Control (MAC) parameters, Physical Layer specifications, and management objects for the transfer of Ethernet format frames at 2.5 Gbps and 5 Gbps over balanced twisted-pair transmission media used in structured cabling are defined in this amendment to IEEE Std 802.3-2015.

IEEE 802.3bs

This amendment includes IEEE 802.3 Media Access Control (MAC) parameters, Physical Layer specifications, and management parameters for the transfer of IEEE 802.3 format frames at 200 Gbps and 400 Gbps.

IEEE 802.3ba

Media Access Control Parameters, Physical Layers and Management Parameters for 40 Gbps and 100 Gbps Operation

The 802.3ba amendment to the IEEE 802.3-2008 standard defines media access control (MAC) parameters, physical layer specifications and management parameters for the transfer of 802.3 frames at 40 Gbps and 100 Gbps. The amendment facilitates the migration of 10 Gigabit Ethernet from the network core to the network edge by providing 40 Gbps and 100 Gbps data rates for backbone and backhaul applications to effectively remove the bandwidth bottleneck that exists in many corporate networks today.

The following media types and distances are approved as part of the 802.3ba amendment:

40 Gigabit Ethernet		
Protocol	Media	Distance
40GBASE-CR4	Twinax	10 m
40GBASE-SR4	OM3 MMF	100 m
40GBASE-SR4	OM4 MMF	150 m
40GBASE-LR4	SMF	10 km

100 Gigabit Ethernet		
Protocol	Media	Distance
100GBASE-CR10	Twinax	10 m
100GBASE-SR10	OM3 MMF	100 m
100GBASE-SR10	OM4 MMF	150 m
100GBASE-LR4	SMF	10 km
100GBASE-ER4	SMF	40 km

Table 57 – 40 Gbps and 100 Gbps approved media types and distances

IEEE 802.11 STANDARDS

Wireless Standard

IEEE 802.11, the Wi-Fi standard, denotes a set of wireless LAN/WLAN standards developed by Working Group 11 of the IEEE LAN/MAN standards committee (IEEE 802). The term 802.11x is also used to denote this set of standards and is not to be mistaken for any one of its elements. There is no single 802.11x standard.

802.11 details a wireless interface between devices to manage packet traffic (to avoid collisions, etc.). Some common specifications and their distinctive attributes include the following:

802.11a – Operates in the 5 GHz frequency range (5.125 to 5.85 GHz) with a maximum 54 Mbps signaling rate. The 5 GHz frequency band isn't as crowded as the 2.4 GHz frequency because it offers significantly more radio channels than the 802.11b and is used by fewer applications. It has a shorter range than 802.11g, is actually newer than 802.11b and is not compatible with 802.11b.

802.11b – Operates in the 2.4 GHz Industrial, Scientific and Medical (ISM) band (2.4 to 2.4835 GHz) and provides signaling rates of up to 11 Mbps. This is a commonly used frequency. Microwave ovens, cordless phones, medical and scientific equipment, as well as Bluetooth devices, all work within the 2.4 GHz ISM band.

802.11e – Ratified by the IEEE in late September 2005, the 802.11e quality-of-service specification is designed to guarantee the quality of voice and video traffic. It is particularly important for companies interested in using Wi-Fi phones.

802.11g – Similar to 802.11b, this standard supports signaling rates of up to 54 Mbps. It also operates in the heavily used 2.4 GHz ISM band but uses a different radio technology to boost overall throughput. Compatible with older 802.11b.

802.11i – Also sometimes called Wi-Fi Protected Access 2 (WPA 2), 802.11i was ratified in June 2004. WPA 2 supports the 128-bit-and-above Advanced Encryption Standard, along with 802.1x authentication and key management features.

802.11k – Passed in June 2008, the 802.11k Radio Resource Management Standard will provide measurement information for access points and switches to make wireless LANs run more efficiently. It may, for example, better distribute traffic loads across access points or allow dynamic adjustments of transmission power to minimize interference.

802.11n – Ratified in September 2009, 802.11n is a set of standards for wireless local area network (WLAN) communications, developed by the IEEE LAN/WAN Standards Committee (IEEE 802) in the 5 GHz and 2.4 GHz public spectrum bands. The proposed amendment improves upon the previous 802.11 standards by adding multiple-input multiple-output (MIMO) and many other newer features.

802.11ac – Published in January 2014 by the IEEE 802.11 LAN/WAN Standards Committee, the standard increases WLAN multi-station throughput from the previous 802.11n standard to at least 1 gigabit per second and to a single link throughput of at least 500 megabits per second (500 Mbit/s). The increased throughput is achieved by utilizing wider RF bandwidth (up to 160 MHz), more MIMO spatial streams (up to eight), downlink multi-user MIMO (up to four clients), and high-density modulation (up to 256-QAM).

802.11ad – This amendment defines modifications to both the IEEE 802.11 physical layers (PHYs) and the IEEE 802.11 medium access control layer (MAC) to enable operation in frequencies around 60 GHz and capable of very high throughput up to 7Gbps.

REFERENCE DOCUMENTS

For further information on cabling standards, please obtain the full versions of the original standards documents.

TIA-568.0-D (2009)

Generic Telecommunications Cabling for Customer Premises

TIA-568.1-D (2009)

Commercial Building Telecommunications Cabling Standard

TIA-568.2-D (2009)

Balanced Twisted-Pair Telecommunications Cabling and Components Standard

TIA-568.3-D (2009)

Optical Fiber Cabling Components

TIA-569-D (2015)

Telecommunications Pathways and Spaces

TIA-606-C (2012)

Administration Standard for Telecommunications Infrastructure

TIA-607-C (2015)

Generic Telecommunications Bonding and Grounding (Earthing) for Customer Premises

TIA-862-B (2011)

Building Automation Systems Cabling Standard

TIA-942-B (2012)

Telecommunications Infrastructure Standard for Data Centers

TIA-1005-A (2012)

Telecommunications Infrastructure Standard for Industrial Premises

TIA-1179-A (2010)

Healthcare Facility Telecommunications Infrastructure Standard

ISO/IEC 11801 (2002)

Generic Cabling for Customer Premises

IEEE 802.3af (2003)

Power over Ethernet (PoE) Standard

IEEE 802.3at (2009)

Power over Ethernet+ (Plus)

IEEE 802.3an (2006)

Physical Layer and Management Parameters for
10 Gbps Operation Type 10GBASE-T

IEEE 802.3ba (2010)

Media Access Control Parameters, Physical Layers and Management
Parameters for 40 Gbps and 100 Gbps Operation

IEEE 802.3bm (2015)

Physical Layer specifications and management parameters for 40
Gbps operation over single-mode fiber (40GBASE-ER4) and for
100 Gbps operation over multimode fiber (100GBASE-SR4)

IEEE 802.3bq (2016)

Physical Coding Sublayer (PCS) interfaces and new
Physical Medium Attachment (PMA) sublayer interfaces
for 25 Gbps Ethernet and 40 Gbps Ethernet

IEEE 802.3bz (2016)

Physical Layer specifications, and management objects for
the transfer of Ethernet format frames at 2.5 Gbps and 5
Gbps over balanced twisted-pair transmission media

IEEE 802.3bs (2017)

Physical Layer specifications, and management parameters for the
transfer of IEEE 802.3 format frames at 200 Gbps and 400 Gbps.

IEEE 802.3bt (2018)

Physical Layer and Management Parameters
for Power over Ethernet over 4 pairs

IEEE 802.11

Wireless Standard

802.11ac (2014)

802.11n (2009)

802.11k (2008)

802.11e (2005)

802.11i (2004)

802.11g (2003)

802.11a (2003)

802.11b (2003)

802.11ac (2014)

802.11ad (2012)

Obtaining Standards Documents

TIA documents may be purchased through the IHS Standards Store (Global Engineering Documents) at 877.413.5184 or global.ihs.com. IEEE documents may be purchased through IEEE, P.O. Box 1331, Piscataway, NJ 08855 or iee.org. CSA documents may be purchased through the Canadian Standards Association at csa.ca or by calling 416.747.4000.

For further assistance or more information, contact your local Anixter sales office or 1.800.ANIXTER. Some material in this publication is reproduced from standards publications, which are copyrighted by the Telecommunications Industry Association.

This document was prepared by Anixter Inc., which is not affiliated with the Telecommunications Industry Association. TIA is responsible for the content of this publication.

For direct assistance in interpreting telecommunications standards, consider Registered Communications Distribution Designers (RCDD) certified by the Building Industry Consulting Service International (BICSI) at 800.242.7405 or bicsi.org. Many Anixter technical professionals are registered with BICSI.

TECHNOLOGY ALLIANCE PARTNERS

From enterprise data centers to security infrastructure to in-building wireless and beyond, Anixter recommends and provides solutions that connect the world's most important information. Delivered directly and through partners, these solutions help today's data-intensive organizations operate more efficiently and maximize the business value of their infrastructures. As a provider of leading-edge solutions, Anixter recognizes the benefits that a joint technology partnership can bring to its customers. That's why Anixter has created the Technology Alliance Partner program with the mission of building long-term partnerships that enable us to deliver comprehensive and proven best-of-breed technology solutions.



Learn more about our Technology Alliance Partner program at anixter.com/techalliance.

GLOBAL REACH. LOCAL ADVANTAGE.

With Anixter, you get a true local partner around the world. No other distributor of our kind can claim an in-country presence in approximately 50 countries and in over 300 cities.

We do business in more than 35 currencies and 30 languages, which means we are uniquely positioned to help facilitate your project in the local environment, reduce risks and keep costs down.

FOUNDED
1957

OVER
9,400
EMPLOYEES

OVER
\$8.8 BILLION
IN SALES

APPROXIMATELY
50
COUNTRIES

IN OVER
300
CITIES

OVER
100,000
CUSTOMERS

NEARLY
600,000
PRODUCTS

OVER
\$1 BILLION
INVENTORY

FORTUNE
500
COMPANY

STOCK SYMBOL
AXE



Build. Connect. Power. Protect. Services. Worldwide.

Anixter Inc. World Headquarters

2301 Patriot Boulevard
Glenview, Illinois 60026
224.521.8000

1.800.ANIXTER | anixter.com

About Anixter: anixter.com/aboutus

Legal Statement: anixter.com/legalstatement

15G5554GL © 2020 Anixter Inc. · 08/20